



# JUPITER

---

## SERIES

A black and white illustration of the Roman god Jupiter, depicted as a muscular man with a beard, wearing a draped garment, and holding a lightning bolt in his right hand.

## Technical Manual

---

**R410A 60Hz 14SEER Top-Discharge Outdoor**



# Content

<b>Part 1. General Information.....</b>	<b>1</b>
1. Nomenclature .....	2
2. Model Names of Indoor/Outdoor Units .....	3
3. External Appearance .....	4
4. Features .....	5
<b>Part 2. Indoor Unit.....</b>	<b>6</b>
1. Features .....	Error! Bookmark not defined.
2. Specification.....	7
3. Dimension .....	10
4. Service Space .....	11
5. Wiring Diagrams.....	12
6. Electric Characteristics .....	14
7. The Specification of Wiring .....	15
8. Field Wiring.....	16
<b>Part 3 Outdoor Unit.....</b>	<b>17</b>
1. Specification .....	18
2. Dimension .....	20
3. Service Space.....	21
4. Wiring Diagrams .....	22
5. Electric Characteristics .....	23
6. Operation Limits.....	24
7. Sound Levels.....	25
8. Refrigerate diagram .....	26
<b>Part 4 Installation.....</b>	<b>27</b>
1. Precaution on Installation .....	28
2. Vacuum Dry and Leakage Checking .....	29
3. Additional Refrigerant Charge .....	31
4. Insulation Work .....	32
5. Test Operation.....	34
<b>Part 5 Unit maintenance.....</b>	<b>35</b>
1. Fault indicator of indoor unit.....	36
2. Fault indicator of outdoor unit.....	37
3. Flow chart of troubleshooting.....	38
4. Exploded views and part list.....	43

## Part 1. General Information

1. Model Names of Indoor/Outdoor Units .....	2
2. External Appearance .....	3
3. Features .....	4

## **1. Nomenclature**

### **1.1 Indoor unit**

**ALB – Air-Con Jupiter Series**

**EM4 – Evaporator**

**H – Heat Pump**

**4 – R410A Refrigerant**

**G – Factory Code**

**24 – Capacity (ex: 24,000 BTU)**

### **1.2 Outdoor unit**

**ALB – Air-Con Jupiter Series**

**CV4 – Condenser**

**H – Heat Pump**

**4 – R410A Refrigerant**

**G – Factory Code**

**24 – Capacity (ex: 24,000 BTU)**

## 2. Model Names of Indoor/Outdoor Units

### 2.1 Indoor Units

Model name	Dimension(W×H×D)(inch)	Power supply
<b>SEER 14 Heat Pump</b>		
ALBEM4H4G24	19-2/3×45-3/4×22	208~230V-1Ph-60Hz
ALBEM4H4G36	19-2/3×45-3/4×22	208~230V-1Ph-60Hz
ALBEM4H4G48	22×53-1/8×24-1/2	208~230V-1Ph-60Hz
ALBEM4H4G60	22×53-1/8×24-1/2	208~230V-1Ph-60Hz

### 2.2 Outdoor Units

Model name	Dimension (W×H×D) (inch)	Power supply
<b>SEER 14 Heat Pump</b>		
ALBCV4H4G24	21-5/6×25×21-5/6	208~230V-1Ph-60Hz
ALBCV4H4G36	29-1/8×25×29-1/8	208~230V-1Ph-60Hz
ALBCV4H4G48	29-1/8×32-5/6×29-1/8	208~230V-1Ph-60Hz
ALBCV4H4G60	29-1/8×32-5/6×29-1/8	208~230V-1Ph-60Hz

## 3. External Appearance

### 3.1 Indoor unit



### 3.2 Outdoor unit



**Note:** Standard outdoor unit is using plastic grill. Metal grill can be customized.

## **4. Features**

### **4.1 Operation features**

- Long Piping & Cost Effective
- Low noise operation, as low as 57dB(A)
- 24V control, time delay relay, fan relay and transformer included.

### **4.2 Performance features**

- AHRI Certified & ETL listed.
- R410A environment friendly refrigerant.
- Wide operation temperature range: Cooling: 64°F-109°F; Heating: 20°F-109°F
- Continuous Cooling Transformation Inner-grooved tube has high thermometric conductivity.

### **4.3 Reliability features**

- Painted galvanized steel cabinet.
- Well-known brand fixed compressor, reliable quality.
- Condenser coils constructed with copper tubing and enhanced aluminum fins.
- 3-speed direct drive motors, provide selections of air flow to meet desired applications.
- Intelligent defrost programs, unit will choose different defrost program according to real condition.




## Part 2. Indoor Unit

1.Features .....	6
2.Specification .....	7
3.Dimension .....	9
4.Service Space .....	10
5.Wiring Diagrams .....	11
6.Electric Characteristics .....	13
7.The Specification of Wiring .....	14
8.Field Wiring .....	15


## 1. Features

(1) “A” shape coils, constructed with copper tubing and enhanced aluminum fins.

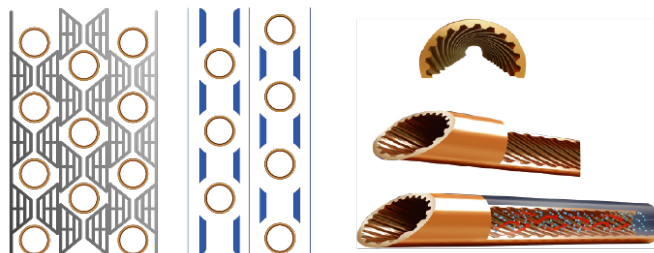


(2) Direct drive motors, 3 speed, provide selections of air flow to meet desired applications.

(3)  $\phi 10''$  large fan blade that has powerful wind speed, and the motor is covered with insulation material, which can ensure that the motor runs in a safe state.

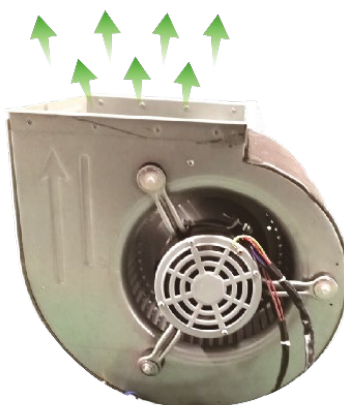


(4) Use TXV as throttle device (14 SEER air handler)

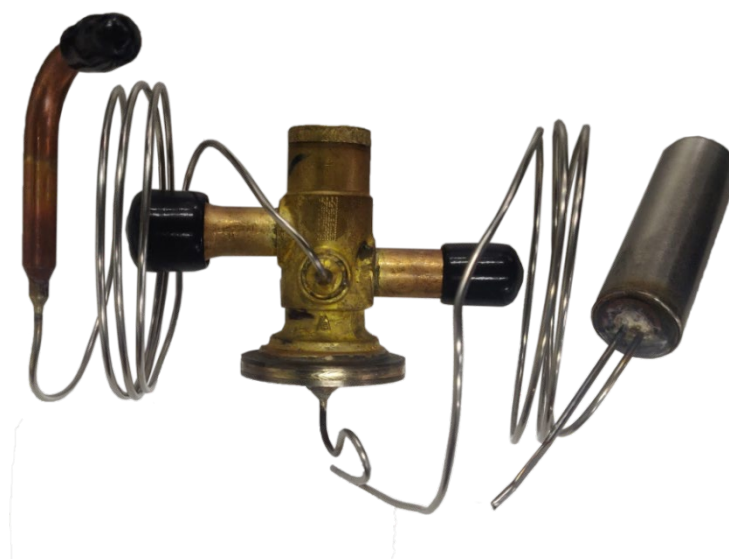

(5) Detachable air filter for cleaning or renewal

Versatile 4-way convertible design for vertical up airflow, horizontal right airflow.

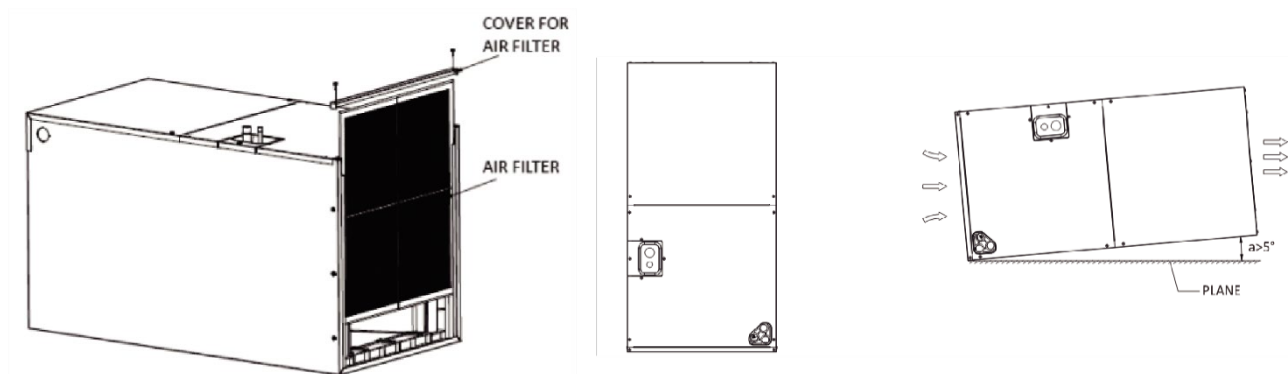

## 2. Specification


Model		ALBEM4H4G24	
Power supply		V/Ph/Hz	208~230V/1N/60Hz
Cooling	Capacity	Btu/h	24000
	SEER	Btu/h.W	14.00
Indoor external static pressure		Pa	25
Throttle type			TXV
Indoor fan motor	Type		PSC
	Input	W	206
	Output	W	135
	Capacitor	μF	6
	Speed (Hi/Me/Lo)	rpm	570/530/490
Indoor air flow		CFM	938/804/738
Indoor noise level		dB(A)	42
Indoor dimension	Unit (WxHxD)	in	19.69×45.75×22.05
	Packing (WxHxD)	in	22.83×47.63×25.59
Net / Gross weight		kg	59/64
		lbs	130/141
Refrigerant piping Liquid side / Gas side		in	3/8 / 3/4

Model			ALBEM4H4G36	ALBEM4H4G48	ALBEM4H4G60
Power supply		V/Ph/H z	208~230V/1N/60Hz	208~230V/1N/60Hz	208~230V/1N/60Hz
Cooling	Capacity	Btu/h	34500	48000	56500
	SEER	Btu/h. W	14.00	14.00	14.00
Indoor external static pressure		Pa	37	50	50
Throttle type			TXV	TXV	TXV
	Type		PSC	PSC	PSC
	Input	W	398	578	578
	Output	W	220	300	300
	Capacitor	μF	10	12	12
	Speed (Hi/Me/Lo)	rpm	805/730/690	920/870/820	920/870/820
Indoor air flow		CFM	1376/1235/1161	1695/1574/1434	1695/1574/1434
Indoor noise level		dB(A)	51	55	55
Indoor dimension	Unit (WxHxD)	in	19.69×45.75×22.05	22.05×53.15×24.53	22.05×53.15×24.53
	Packing (WxHxD)	in	22.83×47.63×25.59	25.20×54.72×27.95	25.20×54.72×27.95

### Notes:

- Nominal cooling capacities are based on the following conditions:  
Indoor temp: 27°CDB, 19°CWB; Outdoor temp: 35°CDB; Equivalent ref. piping: 5m (horizontal)
- Nominal heating capacities are based on the following conditions:  
Indoor temp: 20°CDB; Outdoor temp: 7°CDB, 6°CWB; Equivalent ref. piping: 5m (horizontal)
- Actual noise level may differ, depending on the room structure, etc., since these noise values are from an anechoic room.

### 3. Dimension

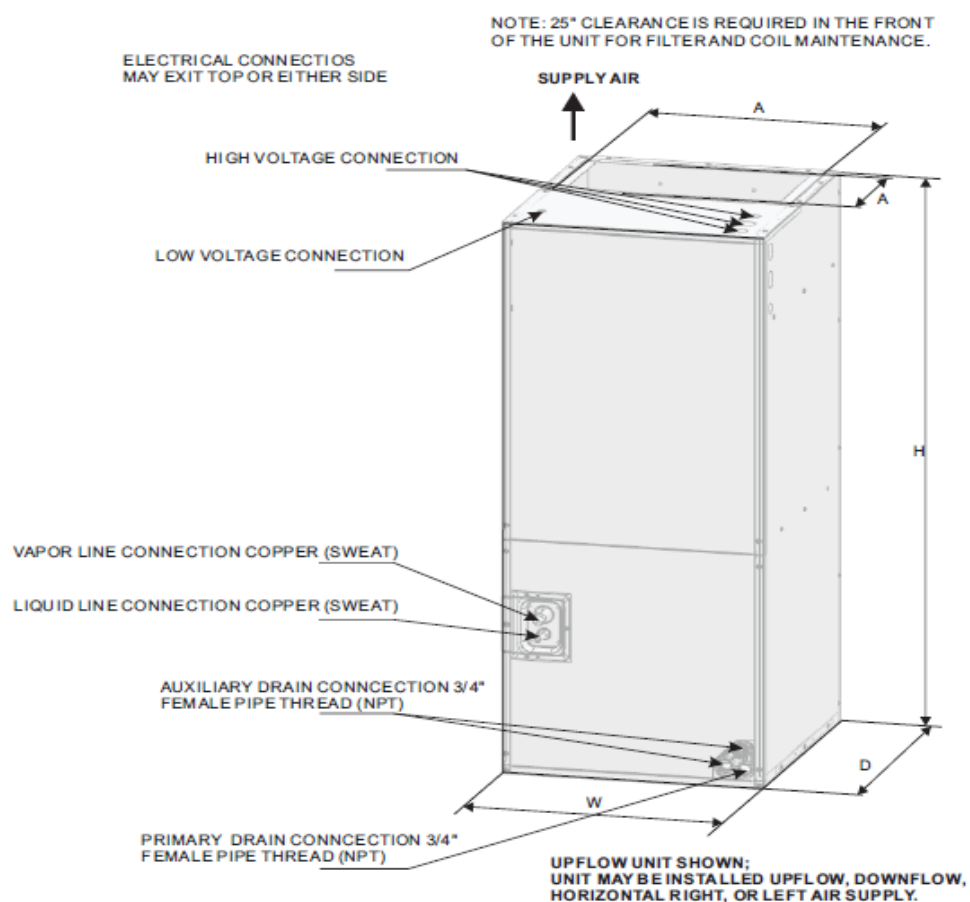

DIMENSIONAL DATA



Fig.1 DIMENSIONS

MODEL SIZE	Dimensions inch [mm]				
	UNIT HEIGHT "H" IN. [mm]	UNIT WIDTH "W" IN. [mm]	UNIT LENGTH "D" IN. [mm]	SUPPLY DUCT "A" IN [mm]	LIQUID LINE/ VAPOR LINE IN
18K	45-3/4" [1162]	19-2/3" [500]	22" [560]	17-7/8" [454]	3/8" / 3/4"
24K	45-3/4" [1162]	19-2/3" [500]	22" [560]	17-7/8" [454]	3/8" / 3/4"
30K	45-3/4" [1162]	19-2/3" [500]	22" [560]	17-7/8" [454]	3/8"   3/4"
36K	45-3/4" [1162]	19-2/3" [500]	22" [560]	17-7/8" [454]	3/8"   3/4"
42K	45-3/4" [1162]	19-2/3" [500]	22" [560]	17-7/8" [454]	3/8"   3/4"
48K	53-1/8" [1350]	22" [560]	24-1/2" [623]	19-1/2" [496]	3/8"   7/8"
60K	53-1/8" [1350]	22" [560]	24-1/2" [623]	19-1/2" [496]	3/8" / 7/8"

## 4. Service Space


The indoor unit should be installed in a location that meets the following requirements:  
INSTALLATION NOTES: .

1. When up hand discharge , how to trap or plug all drains is see the left Figure.
2. When right hand discharge , how to trap or plug all drains is see the top Figure.
3. The seal-plugs are supplied as accessories , and be screwed tightly only with hand.

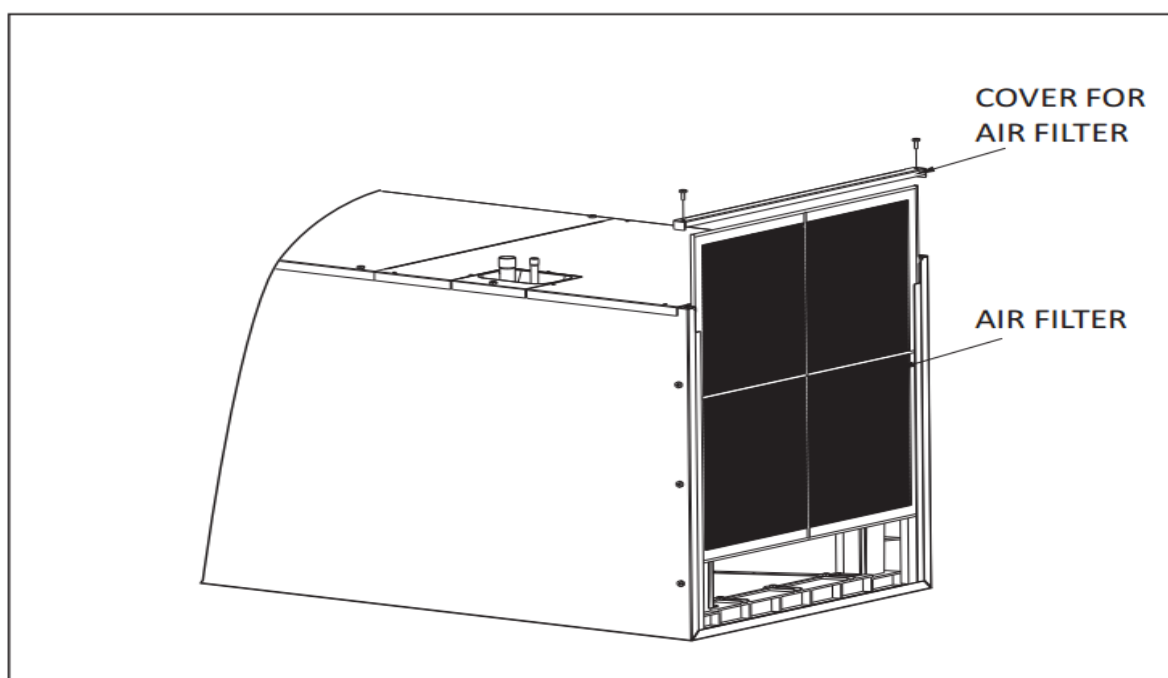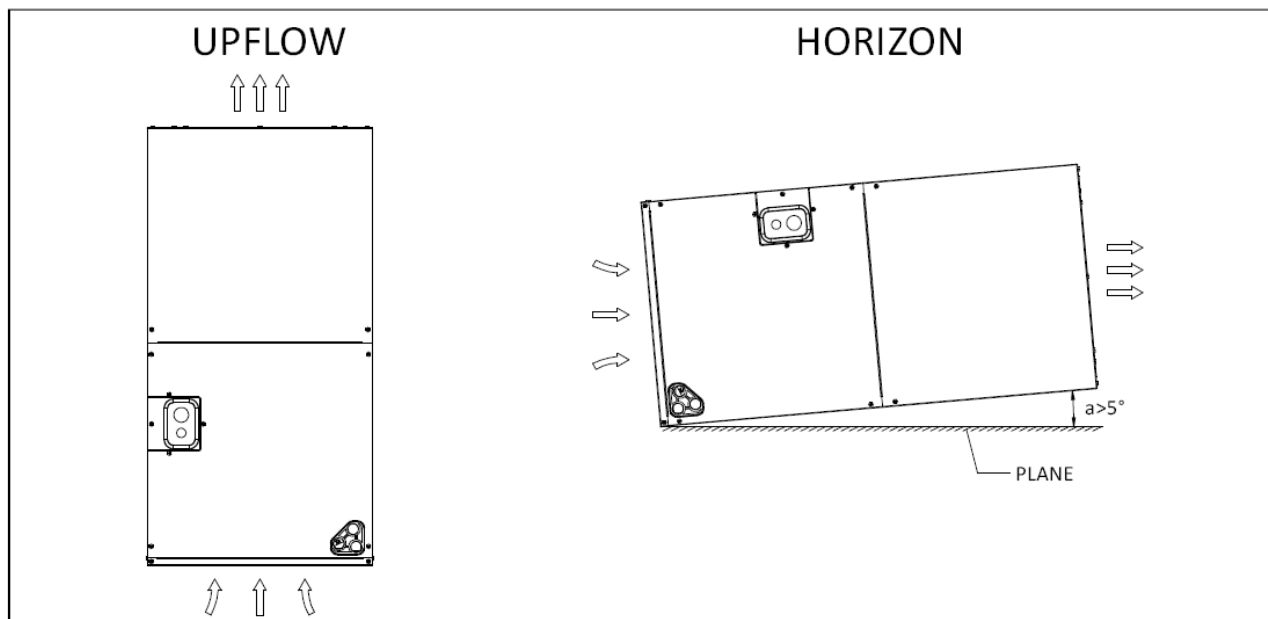


## 5. Wiring Diagrams

18K/24K/30K/36K/42K

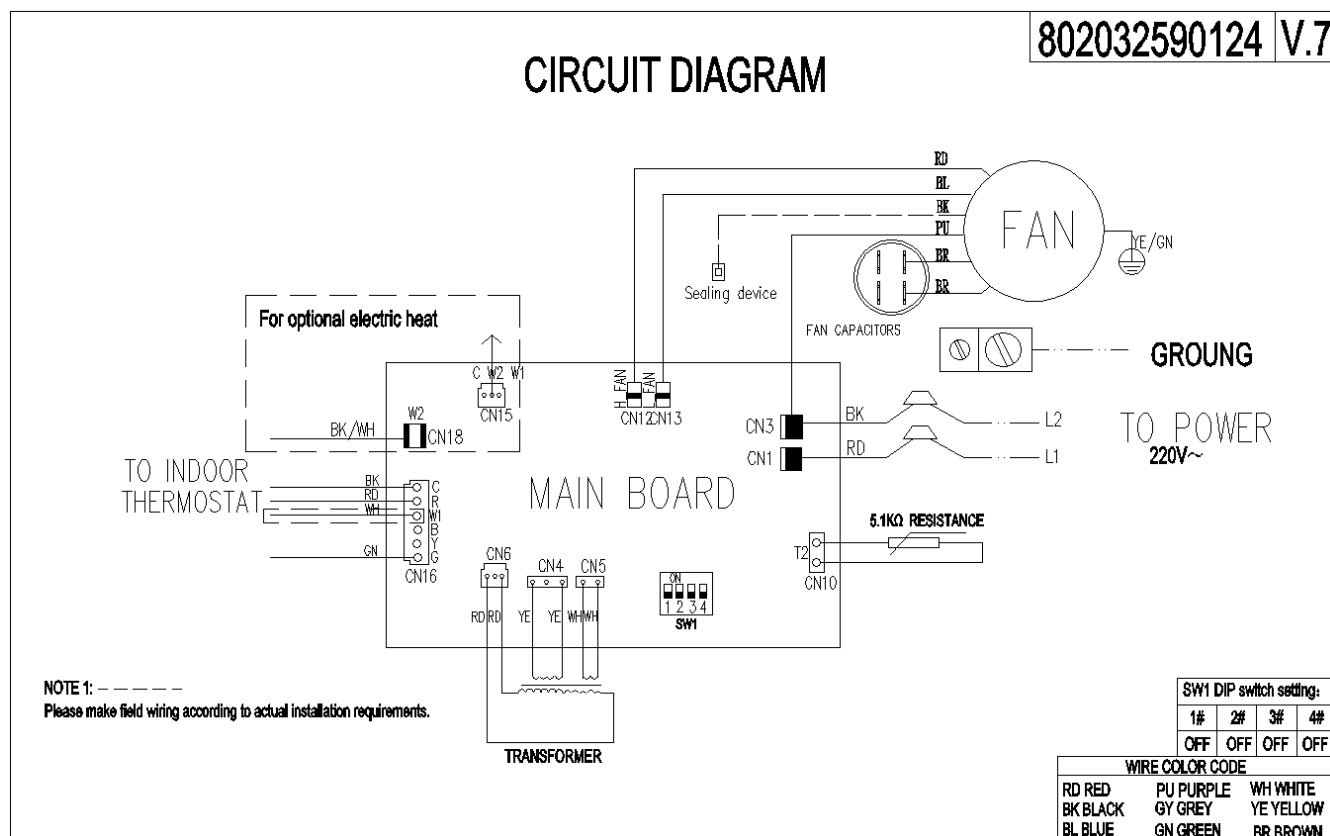


48K

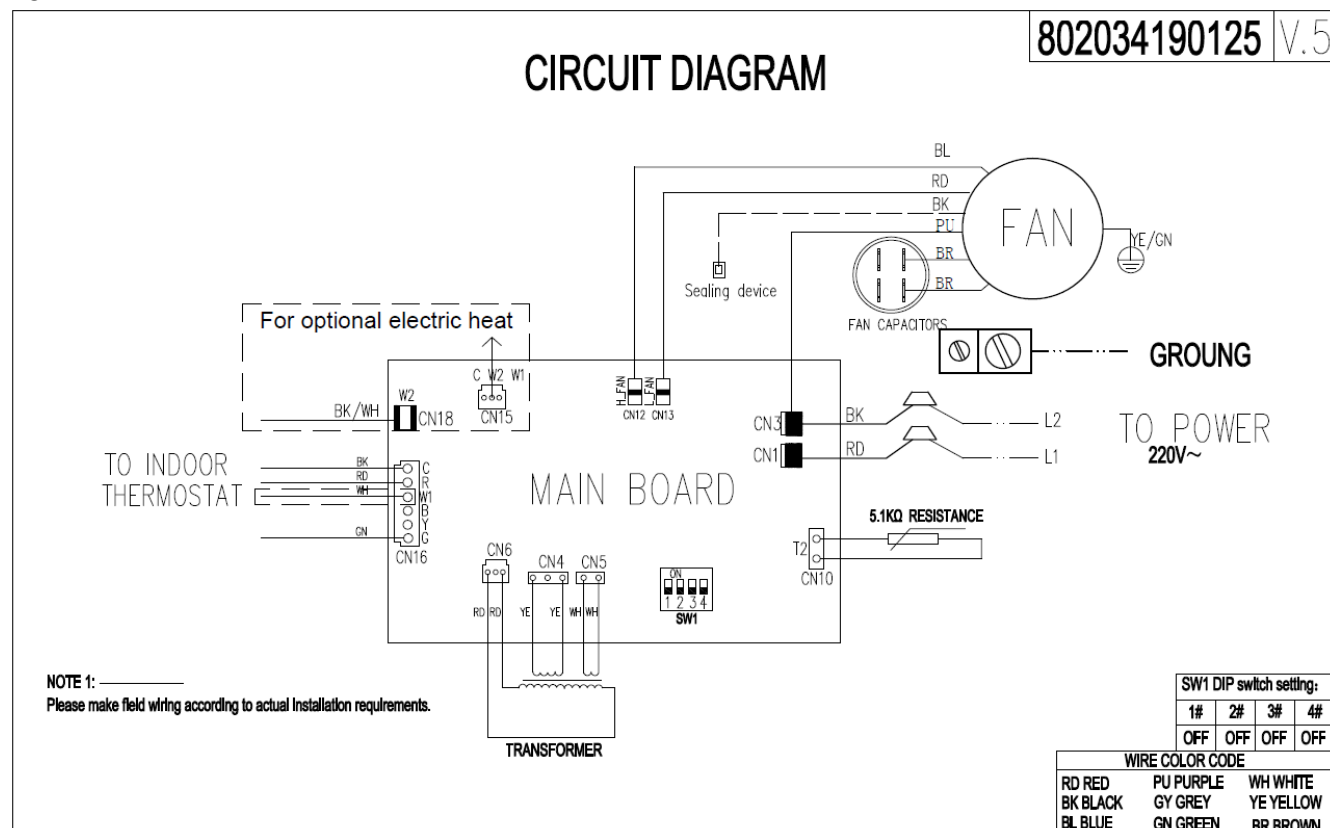

60K

802034590109 V.4

## CIRCUIT DIAGRAM

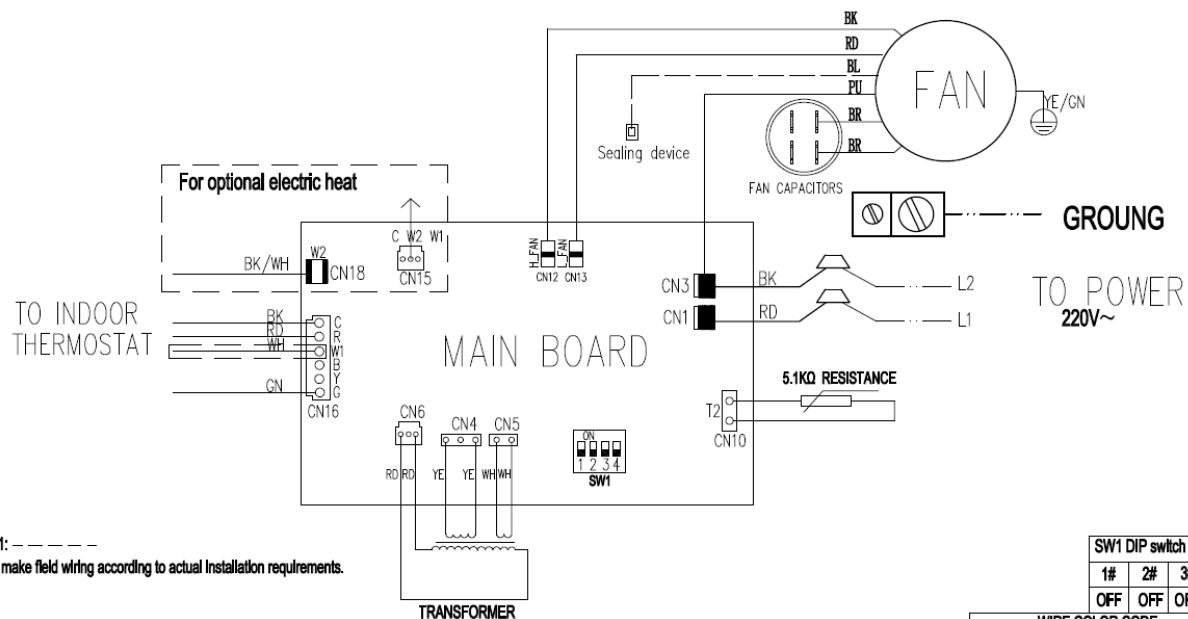



## 6. Electric Characteristics

Model	Indoor Units				Indoor Fan Motor
	Hz	Voltage	Min.	Max.	kW
SEER 14					
ALBEM4H4G24	60	208-230V	198V	242V	0.21
ALBEM4H4G36	60	208-230V	198V	242V	0.40
ALBEM4H4G48	60	208-230V	198V	242V	0.58
ALBEM4H4G60	60	208-230V	198V	242V	0.58

## 7. The Specification of Wiring


### Note:

The cross-section areas of wires or lines should not be less than the corresponding ones listed in the table below; Besides, if the power wires is quite long from the unit, please choose the windings with larger cross-section area to guarantee the normal power supply.


Model	Type	Indoor power wiress	Thermostat communication wiress		Outdoor power wiress
			Indoor	Outdoor	
18 K series (single phase)	Cooling only	3*1.0mm <sup>2</sup>	3*0.75mm <sup>2</sup>	2*0.75mm <sup>2</sup>	3*1.0mm <sup>2</sup>
24 K series (single phase)	Cooling only		3*0.75mm <sup>2</sup>	2*0.75mm <sup>2</sup>	3*2.5mm <sup>2</sup>
30 K series (single phase)	Cooling only		3*0.75mm <sup>2</sup>	2*0.75mm <sup>2</sup>	
36 K series (single phase)	Cooling only		3*0.75mm <sup>2</sup>	2*0.75mm <sup>2</sup>	
42 K series (single phase)	Cooling only		3*0.75mm <sup>2</sup>	2*0.75mm <sup>2</sup>	3*4mm <sup>2</sup>
48 K series (single phase)	Cooling only		3*0.75mm <sup>2</sup>	2*0.75mm <sup>2</sup>	
60 K series (single phase)	Cooling only		3*0.75mm <sup>2</sup>	2*0.75mm <sup>2</sup>	

## 8. Field Wiring

1. To avoid the electrical shock, please connect the air conditioner with the ground lug. The main power plug in the air conditioner has been joined with the ground wiring, please don't change it freely.
2. The power socket is used as the air conditioner specially.
3. Don't pull the power wiring hard.
4. When connecting the air conditioner with the ground, observe the local codes.
5. If necessary, use the power fuse or the circuit, breaker or the corresponding scale ampere.

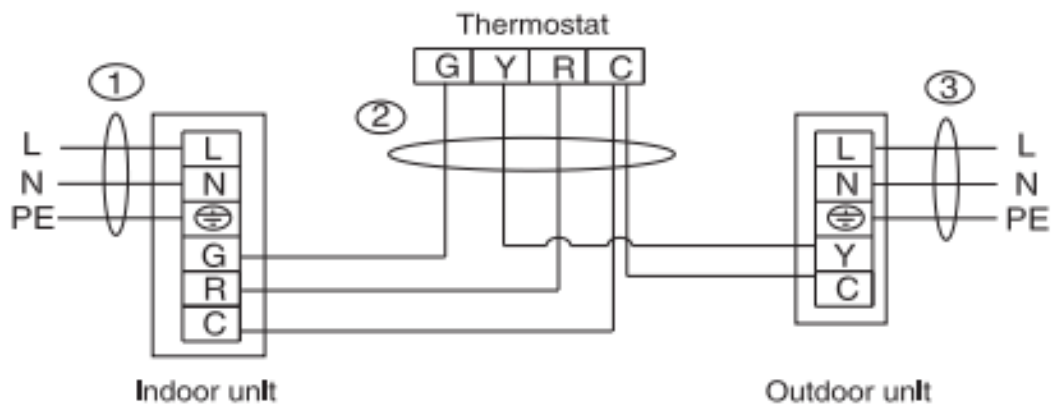

Applicable for 18k, 24k, 30k, 36k, 42k, 48k, 60k cooling only type

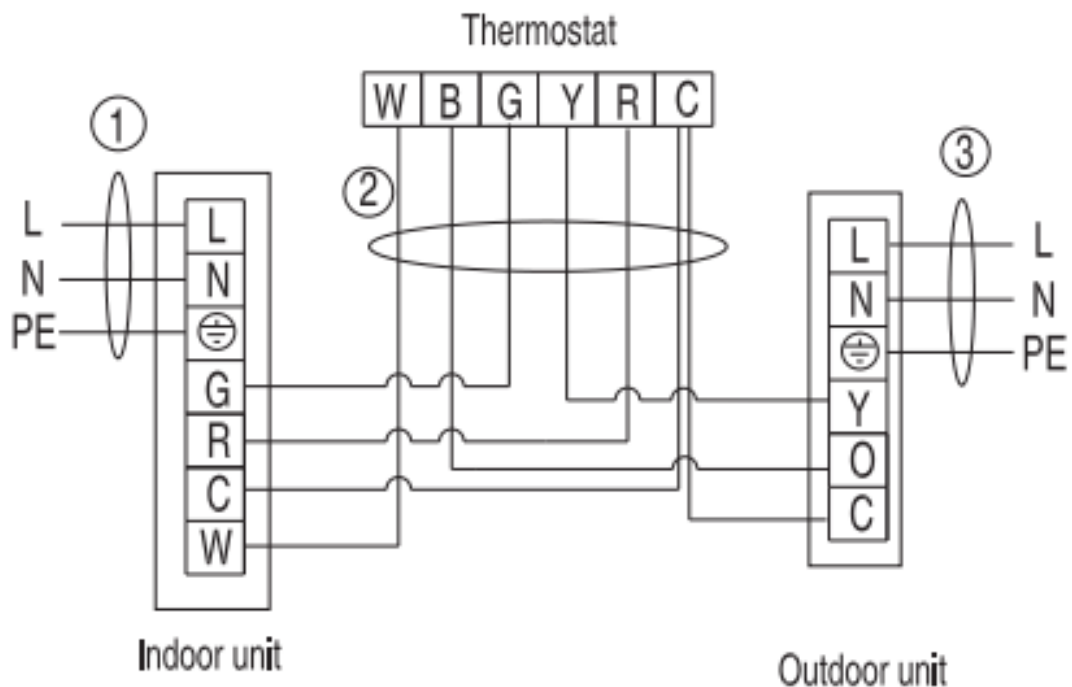

Applicable for 18k, 24k, 30k, 36k, 42k, 48k, 60k cooling & heating type

## Part 3 Outdoor Unit

1. Specification .....	17
2. Dimensions.....	19
3. Service Space .....	20
4. Wiring Diagrams .....	21
5. Electric Characteristics .....	22
6. Operation Limits .....	23
7. Sound Levels.....	24
8. Refrigerate diagram.....	25

# 1. Specification

Model			ALBCV4H4G24	ALBCV4H4G36
Outdoor power supply		V/Ph/Hz	230V/1N/60HZ	230V/1N/60HZ
Cooling	Capacity	Btu/h	24000	34500
	Input	W	1960	2830
	EER	Btu/h .W	12.20	11.70
	SEER ( AHRI Certified)	Btu/h .W	14	14
Max. input consumption		W	2450.00	3573.50
Max. current		A	11.21	16.19
Compressor	Brand		HITACHI	HITACHI
	Model		ASH201DG-C8LU1L	ASH280DG-C8DU
	Type		rotary	rotary
	Capacity	W	5970	8260
	Input	W	1950	2700
	Rated current(RLA)	A	8.7	11.9
	Locked rotor Amp(LRA)	A	44	60
	Thermal protector	uf	40	70
	Refrigerant oil	ml	570	570
Outdoor fan motor	Brand		chigo	chigo
	Model		S.TB-DQ-YDK-85-6P2-AL	S.TB-DQ-YDK-110-8P2-AL
	Input	W	178	207
	Output	W	85	110
	Capacitor	μF	6.00	6.00
	Speed	rpm	970	850
Outdoor coil	Number of row		2	2
	Fin spacing	in	0.055	0.055
	Fin material		non-Hydrophilic Aluminium Fin	non-Hydrophilic Aluminium Fin
	Tube outside diameter	in	Φ 0.276	Φ 0.276
	Tube material		Inner Grooved	Inner Grooved
	Coil length x height x width	in	56.22×23.15×1.05	84.65×23.15×1.05
	Number of circuit		4	6
Outdoor noise level		dB(A)	60	60
Outdoor dimension	Unit (WxHxD)	in	21-5/6×25×21-5/6	29-1/8×25×29-1/8
	Packing (WxHxD)	in	22-5/8×26×22-5/8	30×26×x30
Refrigerant	Type		R410A	R410A
	Charge	ozs	93.47	123.46
Refrigerant pipe	Liquid side	in	Φ3/8	Φ3/8
	Gas side	in	Φ5/8	Φ3/4
	Max. refrigerant pipe length	ft	65 3964	65 3964
	Max. difference in level	ft	32 13/16	32 13/16
Design pressure		MPa	4.0/1.2	4.0/1.2
Max pressure		MPa	4.20	4.20


# 14SEER AIR HANDLER SYSTEM TECHNICAL MANUAL

Model			ALBCV4H4G48	ALBCV4H4G60
Outdoor power supply		V/Ph/H z	230V/1N/60HZ	230V/1N/60HZ
Cooling	Capacity	Btu/h	46000	56500
	Input	W	4088	4920
	EER	Btu/h. W	11.20	11.20
	SEER ( AHRI Certified)	Btu/h. W	14	14
Max. input consumption		W	5110.00	6150.00
Max. current		A	23.39	28.15
Compressor	Brand		LG	LG
	Model		ABG042KAC	ABG051KAC
	Type		scroll	scroll
	Capacity	W	12309	14974
	Input	W	3962	4722
	Rated current(RLA)	A	17.3	21.0
	Locked rotor Amp(LRA)	A	108	128
	Thermal protector	uf	70	70
	Refrigerant oil	ml	1280	1280
Outdoor fan motor	Brand		xinjun	xinjun
	Model		S.TB-DQ-YDK-230-6P2	S.TB-DQ-YDK-230-6P2
	Input	W	510	510
	Output	W	230	230
	Capacitor	μF	12.00	12.00
	Speed	rpm	1095	1095
Outdoor coil	Number of row		2	2.7
	Fin spacing	in	0.055	0.055
	Fin material		non-Hydrophilic Aluminium Fin	non-Hydrophilic Aluminium Fin
	Tube outside diameter	in	Φ 0.276	Φ 0.276
	Tube material		Inner Grooved	Inner Grooved
	Coil length x height x width	in	84.65×31.48×1.05	84.65×31.48×1.05
	Number of circuit		8	8
Outdoor noise level		dB(A)	63	63
Outdoor dimension	Unit (WxHxD)	in	29-1/8×32-5/6×29-1/8	29-1/8×32-5/6×29-1/8
	Packing (WxHxD)	in	30×34-1/2×30	30×34-1/2×30
Refrigerant	Type		R410A	R410A
	Charge	ozs	148.15	178.13
Refrigerant pipe	Liquid side	in	Φ3/8	Φ3/8
	Gas side	in	Φ3/4	Φ7/8
	Max. refrigerant pipe length	ft	65 39/64	65 39/64
	Max. difference in level	ft	32 13/16	32 13/16
Design pressure		MPa	4.0/1.2	4.0/1.2
Max pressure		MPa	4.20	4.20

## 2. Dimension


All dimensions are in mm. They are subject to change without notice. Certified dimensions will be provided upon request.

Unit Model	Dimensions(mm)			Refrigerant Connection Line Size(mm)			
	A	B	C	Liquid(Φ)		Vapor(? )	
				LF	RF	LF	RF
18	633	554	554	9.52	19.05		
24(30)	633	554	554				
30	633	554	554				
36	633	740	740				
42	835	740	740				
48	835	740	740				
60	835	740	740		22		

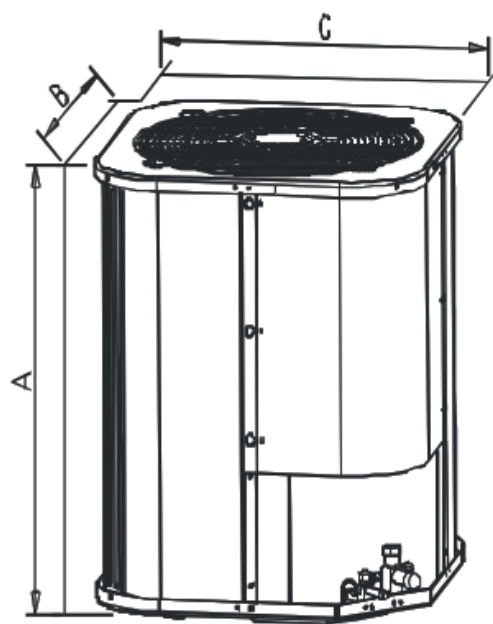


NOTE: LF means cooling only model; RF means heat pump model.

### 3. Service Space

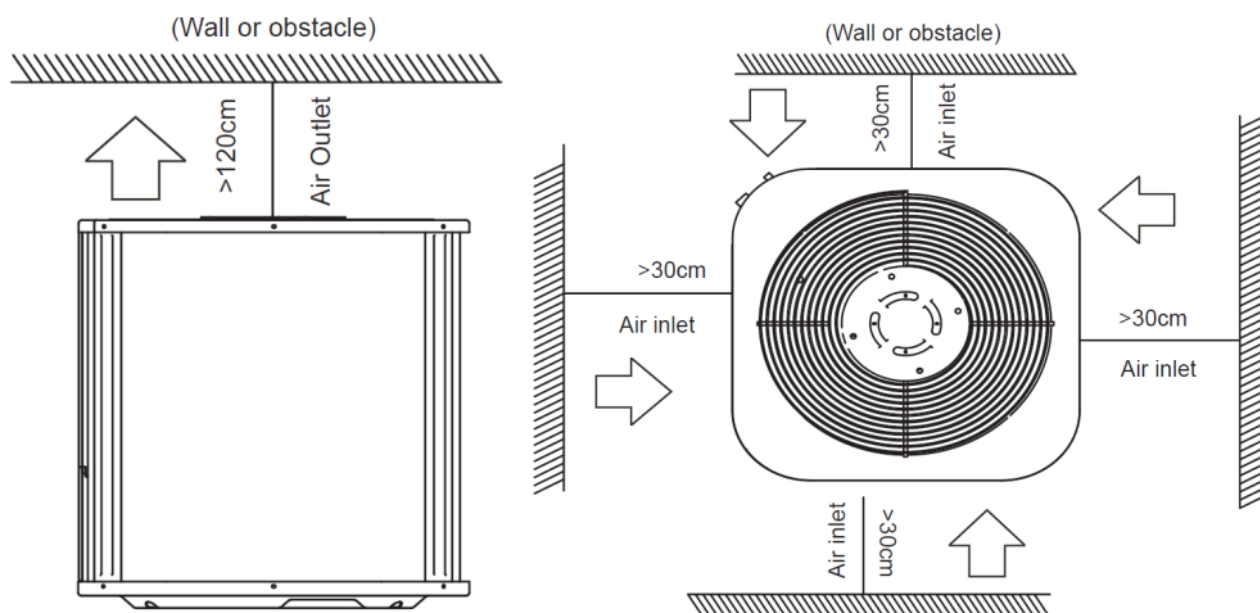

### TYPICAL INSTALLATION

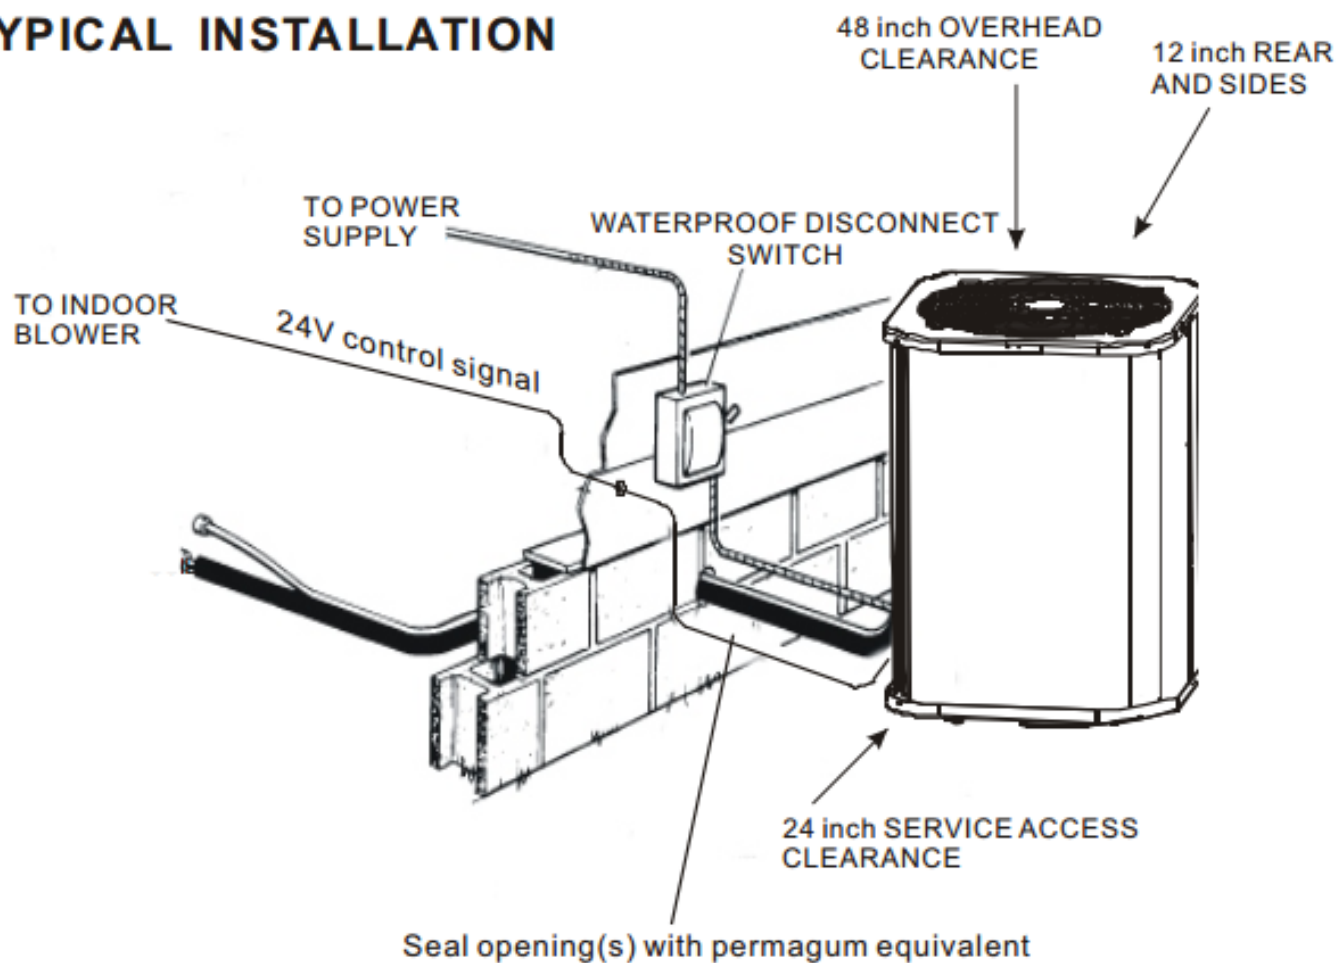






## 5. Electric Characteristics


Model	Outdoor Unit				
	Hz	Voltage	Min.	Max.	Outdoor motor (kw)
ALBCV4H4G24	60	208~230V	198V	242V	0.18
ALBCV4H4G36	60	208~230V	198V	242V	0.21
ALBCV4H4G48	60	208~230V	198V	242V	0.51
ALBCV4H4G60	60	208~230V	198V	242V	0.51

## 6. Operation Limits

Operation mode	Outdoor temperature(°C)	Room temperature(°C)
Cooling operation	18~43	17~30

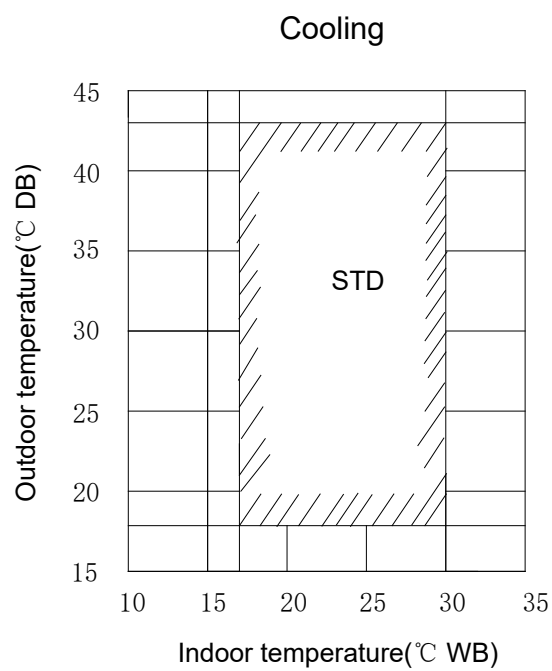

## 7. Sound Levels

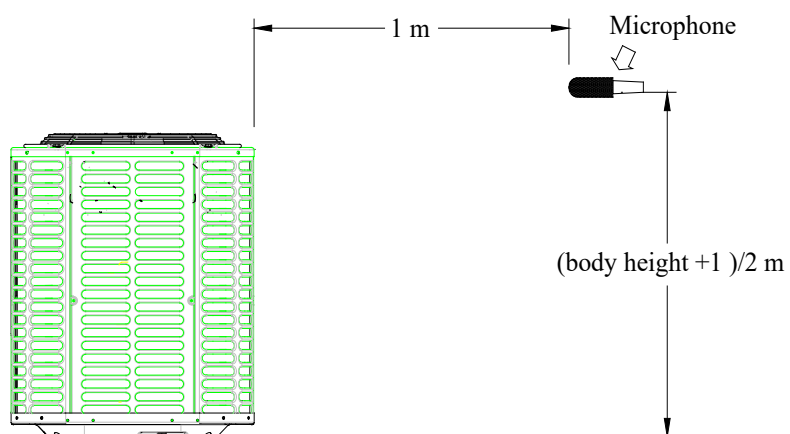


Model	Noise level dB(A)
ALBCV4H4G24	56
ALBCV4H4G36	60
ALBCV4H4G48	63
ALBCV4H4G60	63


Note: Sound level is measured at a point 1 m in front of the unit, at a height of (Unit body height +1)/2 m.

## 8. Refrigerate diagram

Applicable for 18K,24K,30K,36K cooling only type

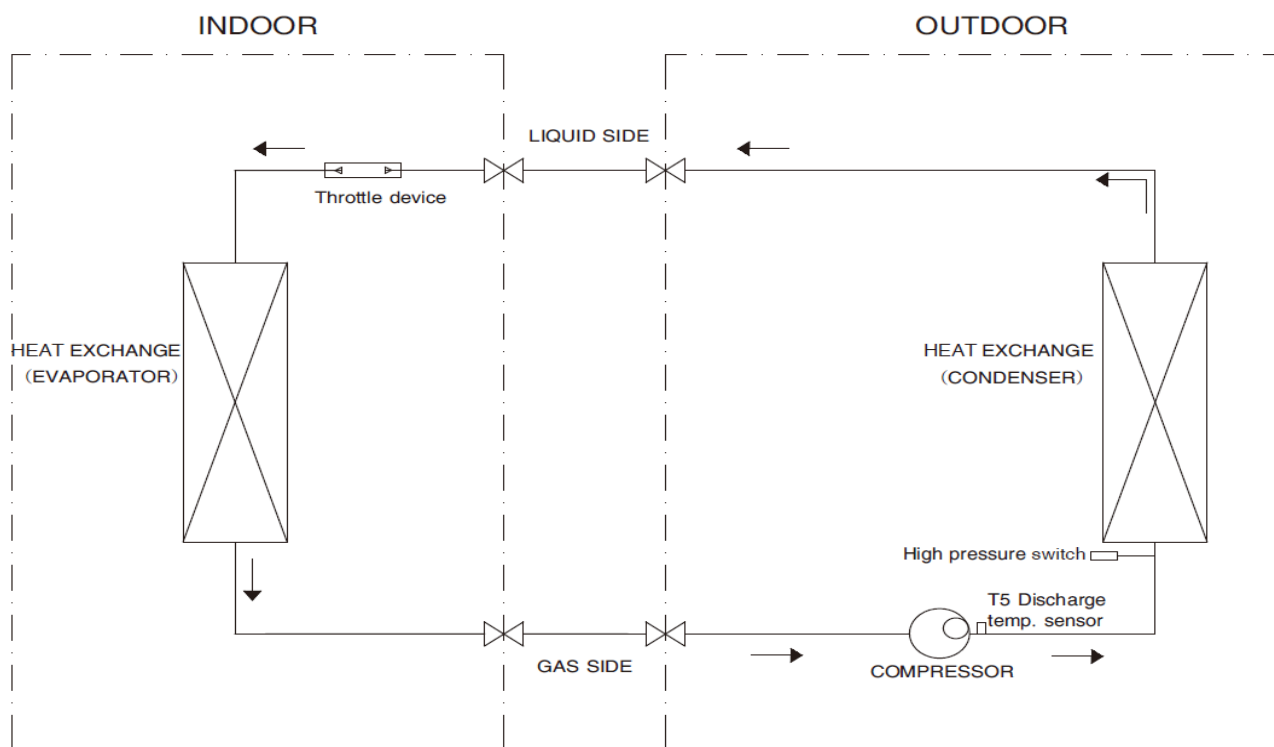

Applicable for 42K,48K, 60K cooling only type

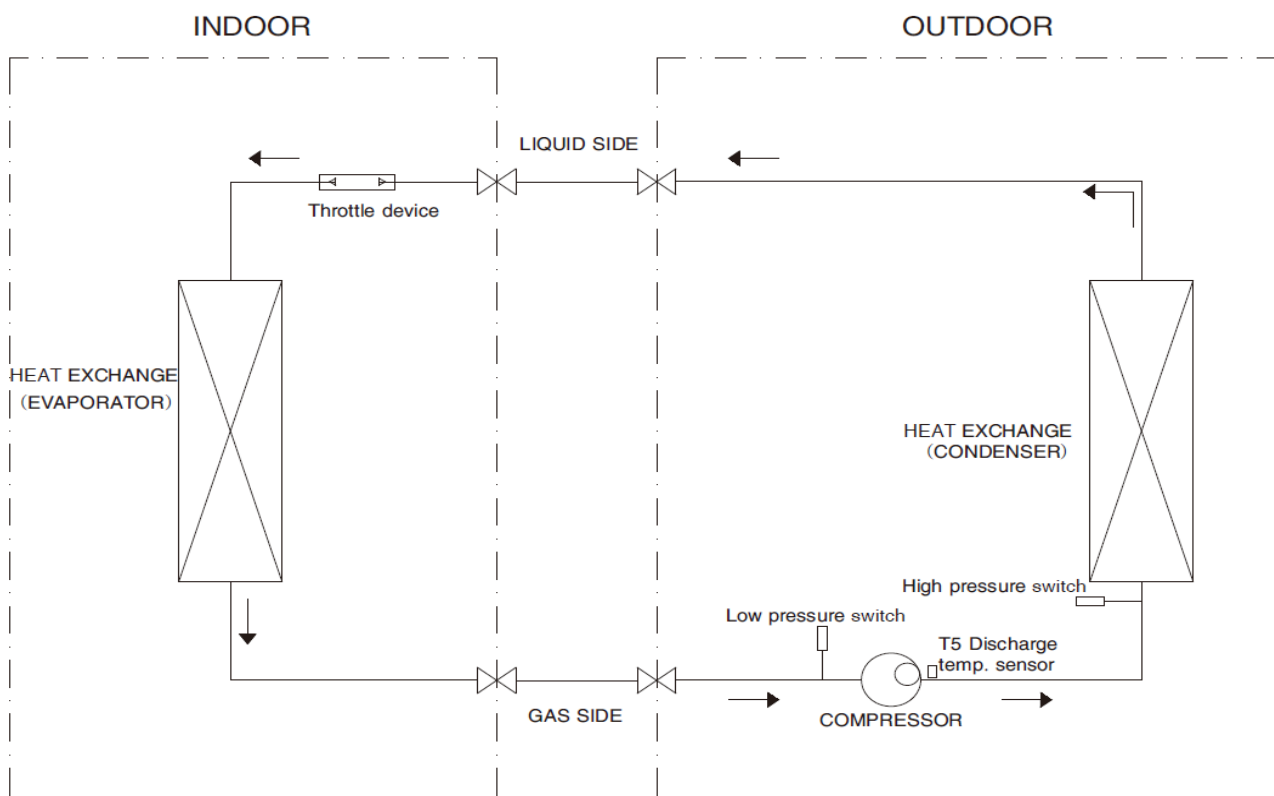

## Part 4 Installation

1 .Precaution on Installation .....	27
2. Vacuum Dry and Leakage Checking .....	28
3. Additional Refrigerant Charge .....	30
4. Insulation Work.....	31
5. Test Operation .....	33

# 1. Precaution on Installation


## 1.1. Measure the necessary length of the connecting pipe, and make it by the following way.

- a. Connect the indoor unit at first, then the outdoor unit.  
Bend the tubing in proper way. Do not harm them.

### CAUTIONS:

- Daub the surfaces of the flare pipe and the joint nuts with frozen oil, and wrench it for 3~4 rounds
- With hands before fasten the flare nuts.

Be sure to use two wrenches simultaneously when you connect or disconnect the pipes.

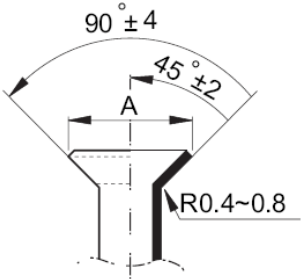Pipe gauge	Tightening torque	Flare dimension A		Flare shape
		Min (mm)	Max	
Φ6.35	15~16N.m (153~163 kgf.cm)	8.3	8.7	
Φ9.52	25~26N.m (255~265kgf.cm)	12.0	12.4	
Φ12.7	35~36N.m (357~367kgf.cm)	15.4	15.8	
Φ15.9	45~47N.m (459~480 kgf.cm)	18.6	19.1	
Φ19.1	65~67N.m (663~684kgf.cm)	22.9	23.3	

- b. The stop value of the outdoor unit should be closed absolutely (as original state). Every time you connect it, first loosen the nuts at the part of stop value, then connect the flare pipe immediately (in 5 minutes). If the nuts have been loosened for a long time, dusts and other impurities may enter the pipe system and may cause malfunction later. So please expel the air out of the pipe with refrigerant before connection.
- c. Expel the air after connecting the refrigerant pipe with the indoor unit and the outdoor unit. Then fasten the nuts at the repair-points.

## 1.2. Locate The Pipe

- a. Drill a hole in the wall (suitable just for the size of the wall conduit), then set on the fittings such as the wall conduit and its cover.
- b. Bind the connecting pipe and the cables together tightly with binding tapes. Do not let air in, which will cause water leakage by condensation.
- c. Pass the bound connecting pipe through the wall conduit from outside. Be careful of the pipe allocation to do no damage to the tubing.

## 1.3. Connect the pipes.


**1.4. Then, open the stem of stop values of the outdoor unit to make the refrigerant pipe connecting the indoor unit with the outdoor unit in fluent flow.**

**1.5. Be sure of no leakage by checking it with leak detector or soap water.**

**1.6. Cover the joint of the connecting pipe to the indoor unit with the soundproof / insulating sheath (fittings), and bind it well with the tapes to prevent leakage.**

## 2. Vacuum Dry and Leakage Checking

**2.1 Vacuum Dry:** use vacuum pump to change the moisture (liquid) into steam (gas) in the pipe and discharge it out of the pipe to make the pipe dry. Under one atmospheric pressure, the boiling point of water (steam temperature) is 100°C. Use vacuum pump to make the pressure in the pipe near vacuum state, the boiling point of water falls relatively. When it falls under outdoor temperature, the moisture in the pipe will be vaporized.

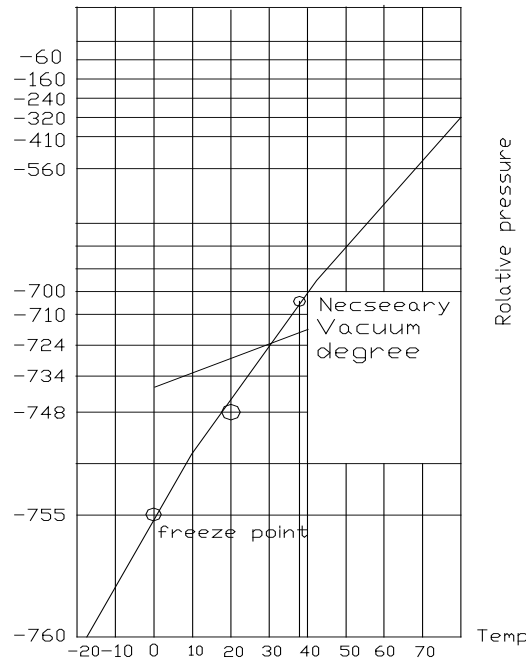


### 2.2 Vacuum dry procedure

There are two methods of vacuum dry due to different construction environment: common vacuum dry, special vacuum dry.

#### ①. Common vacuum dry procedure

- Vacuum dry (for the first time)---connect the all-purpose detector to the inlet of liquid pipe and gas pipe, and run the vacuum pump more than two hours (the vacuum pump should be below -755mmHg)
- If the pump can't achieve below -755mmHg after pumping 2 hours, moisture or leakage point will still exist in the pipe. At this time, it should be pumped 1 hour more.
- If the pump can't achieve -755mmHg after pumping 3 hours, please check if there are some leakage points.
- Vacuum placement test: place 1 hour when it achieves -755mmHg, pass if the vacuum watch shows no rising. If it rises, it shows there's moisture or leakage point.
- Vacuuming from liquid pipe and gas pipe at the same time.
- Sketch map of common vacuum dry procedure.



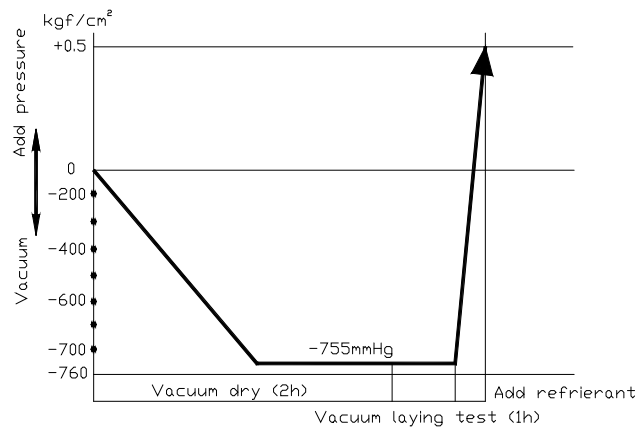

## ②. Special vacuum dry procedure

- This vacuum dry method is used in the following conditions:
- There's moisture when flushing the refrigerant pipe.
- Rainwater may enter into the pipe.
- Vacuum dry for the first time ..... 2h pumping

## ③. Vacuum destroy for the second time ..... Fill nitrogen to 0.5Kgf/cm<sup>2</sup>

Because nitrogen is for drying gas, it has vacuum drying effect during vacuum destroy. But if the moisture is too much, this method can't dry thoroughly. So, please pay more attention to prevent water entering and forming condensation water.


## ④. Vacuum dry for the second time.....1h pumping

Determinant: Pass if achieving below -755mmHg. If -755mmHg can't be achieved in 2h, repeat procedure

③ and ④.

## ⑤. Vacuum placing test ..... 1h

## ⑥. Sketch map of special vacuum dry procedure

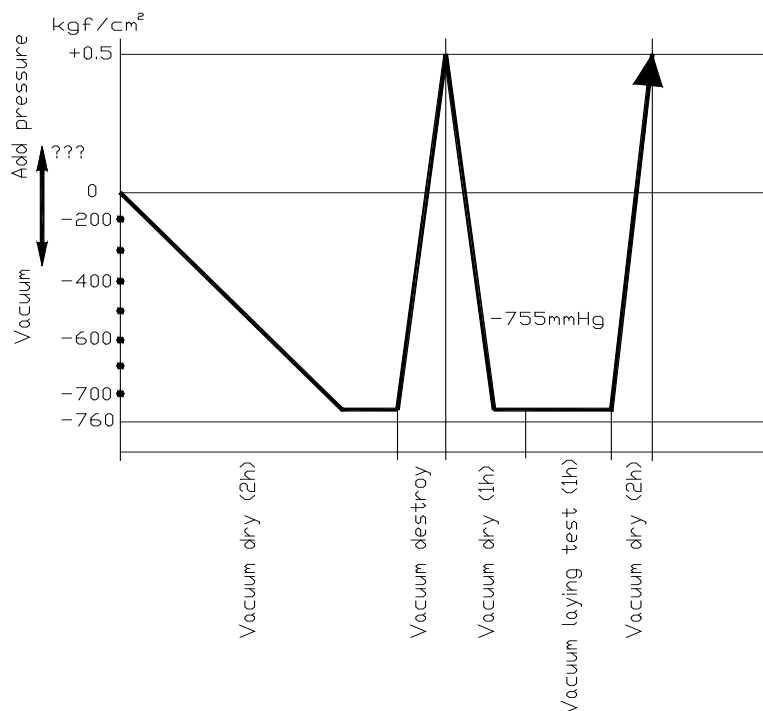

### 3. Additional Refrigerant Charge

#### Caution

- Refrigerant cannot be charged until field wiring has been completed.
- Refrigerant may only be charged after performing the leak test and the vacuum pumping.
- When charging a system, care shall be taken that its maximum permissible charge is never exceeded, in view of the danger of liquid hammer.
- Charging with an unsuitable substance may cause explosions and accidents, so always ensure that the appropriate refrigerant is charged.
- Refrigerant containers shall be opened slowly.
- Always use protective gloves and protect your eyes when charging refrigerant.

The outdoor unit is factory charged with refrigerant. Calculate the added refrigerant according to the diameter and the length of the liquid side pipe of the outdoor unit/indoor unit

R(g) \ D(mm)	φ6.35	Φ9.52	Φ12.7
L(m)			
Less than 5m (One-way)	—	—	—
Added Refrigerant When Over 5m(One-way)	$20\text{g/m} \times (\text{L}-5)$	$40\text{g/m} \times (\text{L}-5)$	$60\text{g/m} \times (\text{L}-5)$

#### Remark:

R (g): Additional refrigerant to be charged

L (m): The length of the refrigerant pipe (one-way)

D (mm): Liquid side piping

## 4. Insulation Work

### 4.1 Insulation material and thickness

#### 4.1.1. Insulation material

Insulation material should adopt the material which is able to endure the pipe's temperature: no less than 70℃ in the high-pressure side, no less than 120℃ in the low-pressure side (For the cooling type machine, no requirements at the low-pressure side.)

- ◆ Example: Heat pump type----Heat-resistant Polyethylene foam (withstand above 120℃)  
Cooling only type----Polyethylene foam (withstand above 100℃)

#### 4.1.2. Thickness choice for insulation material

Insulation material thickness is as follows:




	Pipe diameter (mm)	Adiabatic material thickness
Refrigerant pipe	Φ6.4—Φ25.4	10mm
	Φ28.6—Φ38.1	15mm
Drainage pipe	Inner diameter Φ20—Φ32	6mm

### 4.2 Refrigerant pipe insulation

#### 4.2.1. Work Procedure

- ① Before laying the pipes, the non-jointing parts and non-connection parts should be heat insulated.
- ② When the gas proof test is eligible, the jointing area, expanding area and the flange area should be heat insulated.


#### 4.2.2. Insulation for non-jointing parts and non-connection parts

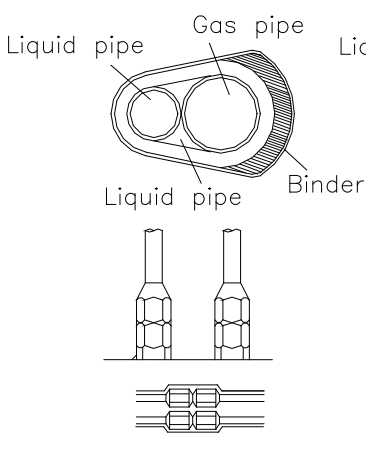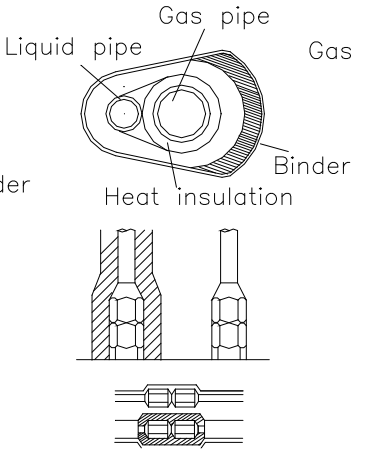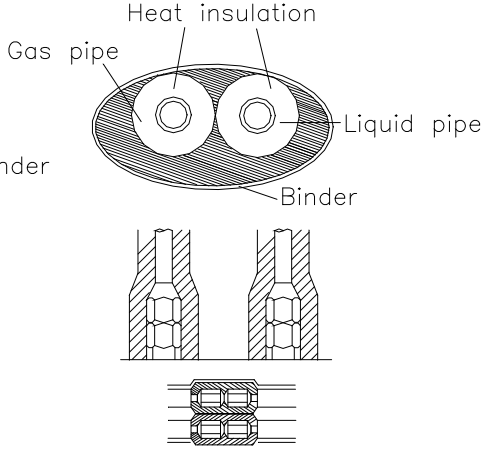wrong	right	
Gas pipe and liquid pipe should not be put together to insulate	Insulate the gas pipe (cooling only)	Insulate the gas pipe and liquid pipe
		

For construction convenience, before laying pipes, use insulation material to insulate the pipes to be deal with, at the same time, at two ends of the pipe, remain some length not to be insulated, in order to be welded and check the leakage after laying the pipes.

### 4.2.3. Insulate for the jointing area, expanding area and the flange area

- ① Insulate for the jointing area, expanding area and the flange area should be done after checking leakage of the pipes
- ② Make sure there's no clearance in the joining part of the accessorial insulation material and local preparative insulation material.

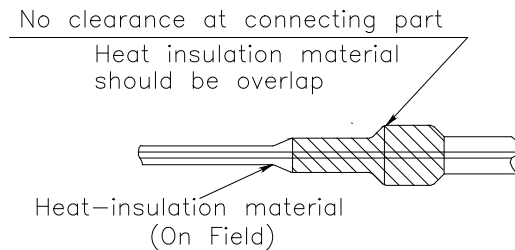

### 4.3 Drainage pipe insulation

The connection part should be insulated, or else water will be condensing at the non-insulation part.

#### 4.4 Note

5.4.1 The jointing area, expanding area and the flange area should be heat insulated after passing the pressure test.

4.4.2 The gas and liquid pipe should be heat insulated individually, the connecting part should be heat insulated individually.

4.4.3 Use the attached heat-insulation material to insulate the pipe connections (pipes' tie-in ,expand nut ) of the indoor unit.

## 5. Test Operation

**(1) The test operation must be carried out after the entire installation has been completed.**

**(2) Please confirm the following points before the test operation.**

- The indoor unit and outdoor unit are installed properly.
- Tubing and wiring are correctly completed.
- The refrigerant pipe system is leakage-checked.
- The drainage is unimpeded.
- The ground wiring is connected correctly.
- The length of the tubing and the added stow capacity of the refrigerant have been recorded.
- The power voltage fits the rated voltage of the air conditioner.
- There is no obstacle at the outlet and inlet of the outdoor and indoor units.
- The gas-side and liquid-side stop valves are both opened.
- The air conditioner is pre-heated by turning on the power.

**(3) According to the user's requirement, install the remote controller when the remote controller's signal can reach the indoor unit smoothly.**

**(4) Test operation**

Set the air conditioner under the mode of "COOLING" with the remote controller, and check the following points.

### Indoor unit

- Whether the switch on the remote controller works well.
- Whether the buttons on the remote controller works well.
- Whether the air flow louver moves normally.
- Whether the room temperature is adjusted well.
- Whether the indicator lights normally.
- Whether the temporary buttons works well.
- Whether the drainage is normal.
- Whether there is vibration or abnormal noise during operation.

### Outdoor unit

- Whether there is vibration or abnormal noise during operation.
- Whether the generated wind, noise, or condensed of by the air conditioner have influenced your neighborhood.
- Whether any of the refrigerant is leaked.

## Part 5 Unit maintenance

1 .Fault indicator of indoor unit.....	35
2. Fault indicator of outdoor unit.....	36
3 .Flow chart of troubleshooting .....	37
4. Exploded views and part list.....	42

## 1. Fault indicator of indoor unit

The meaning of the fault indicator:

Display mode	Status description
Green light always on	No system alarm and error, normal standby
Red light always on	Evaporator tube temperature sensor( T 2 ) failure
Green light always on, yellow light flashing	Evaporator high and low temperature protection
Green light flashing	System is in normal operating status

## 2. Fault indicator of outdoor unit


The meaning of the fault indicator:

Display content		State description
No alarm: Green light flashes Yellow lights	Green light slow flash	Normal standby
	Green light normally on	Normal operation
System Alarm: Green light slow flash Yellow light flashing	(T3)Temperature sensor fault	Yellow light flashes 2 times every 8s
	(T5)Temperature sensor fault	Yellow light flashes 8 times every 8s
	Low pressure alarm	Yellow light flashes 6 times every 8s
	High pressure alarm	Yellow light flashes 1 times every 8s
	(T3)High temperature protection	Yellow light flashes 9 times every 8s
	High exhaust temperature protection	Yellow light flashes 5 times every 8s
System lock: Green light go out Yellow light normally on	3 high/low voltage protection in 20 minutes	It needs to be reenergized and it needs to work
	Exhaust temperature is too high for 3 times within 20 minutes	
	T3 high temperature protection 3 times within 20 minutes	




### 3.Flow chart of troubleshooting


#### 3.1 Evaporator temperature sensor fault

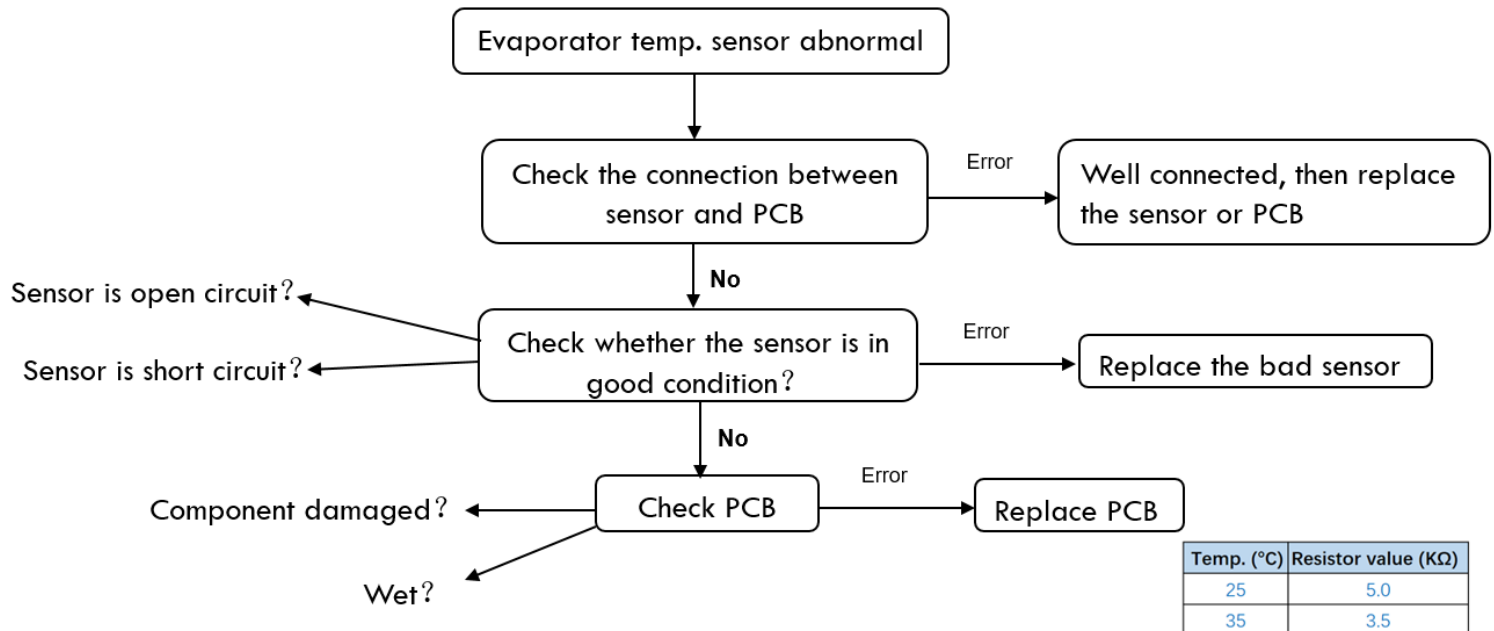


#### 3.2 Evaporator high temperature protection(For heating mode)

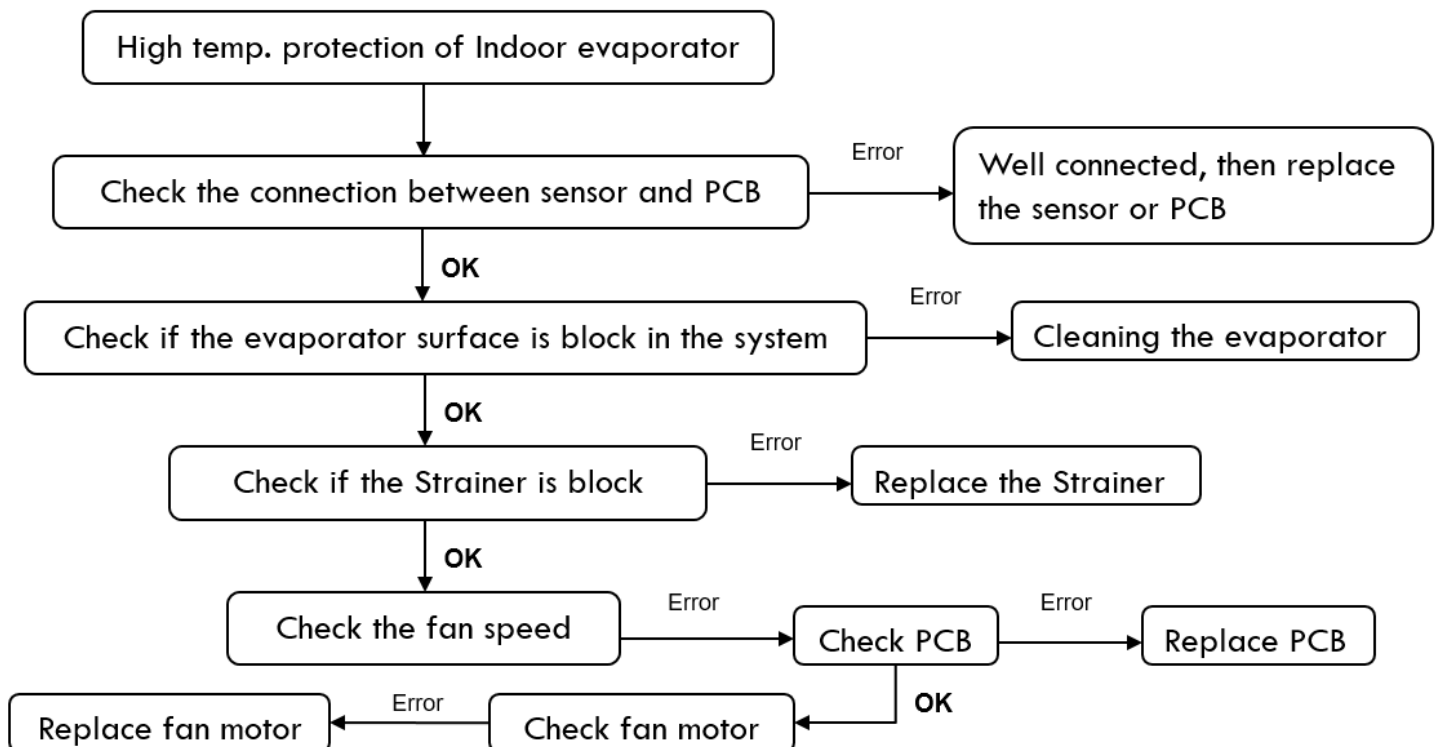

### 3.3 Evaporator low temperature protection(For cooling mode)

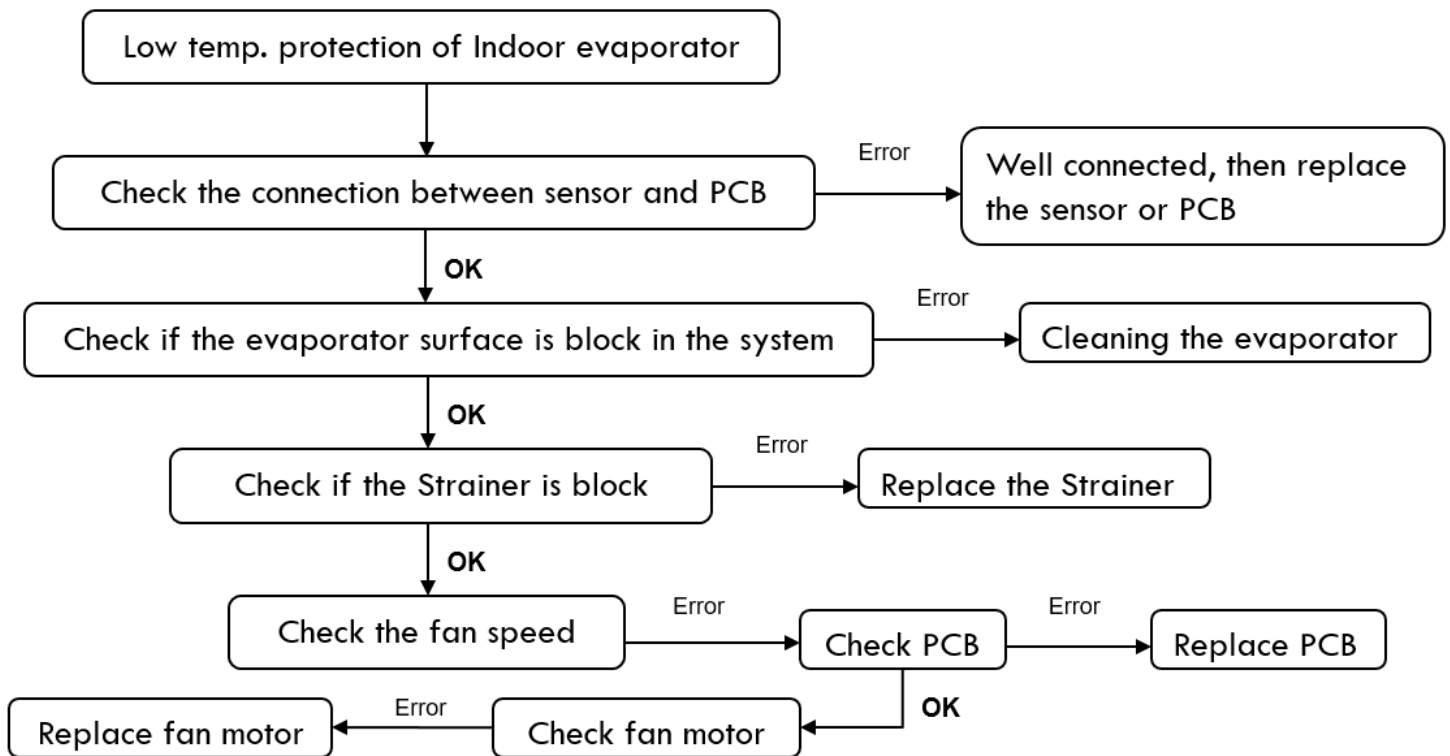


### 3.4 T3 Condenser Temperature sensor fault

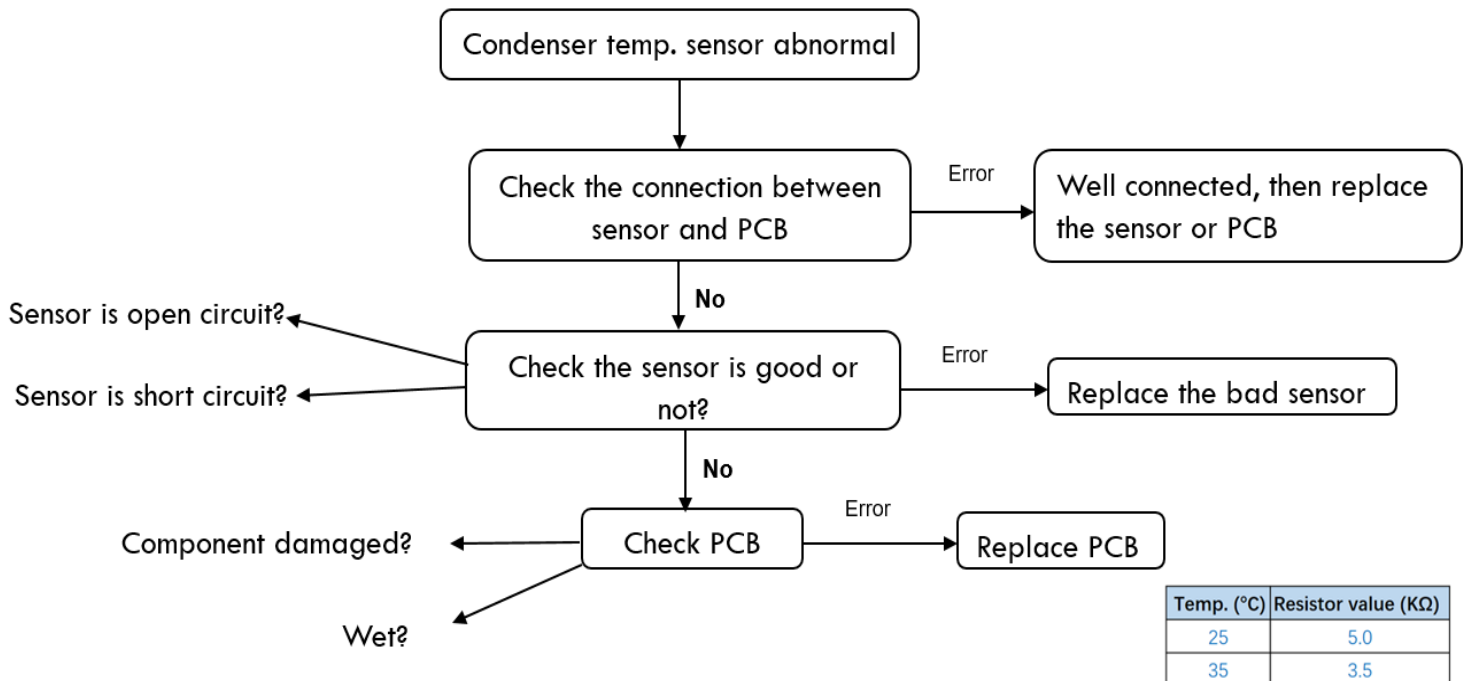


Temp. (°C)	Resistor value (KΩ)
25	5.0
35	3.5


### 3.5 T5 discharge temperature sensor fault

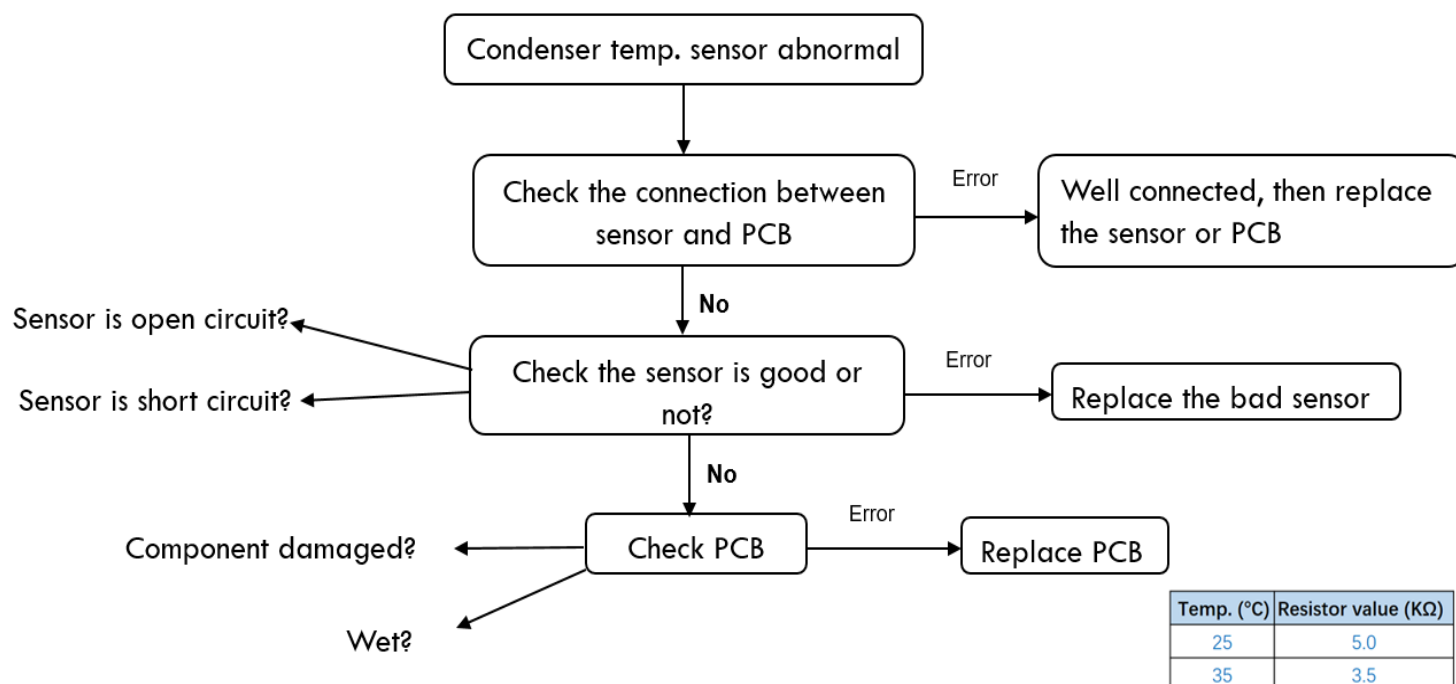


### 3.6 Low pressure alarm

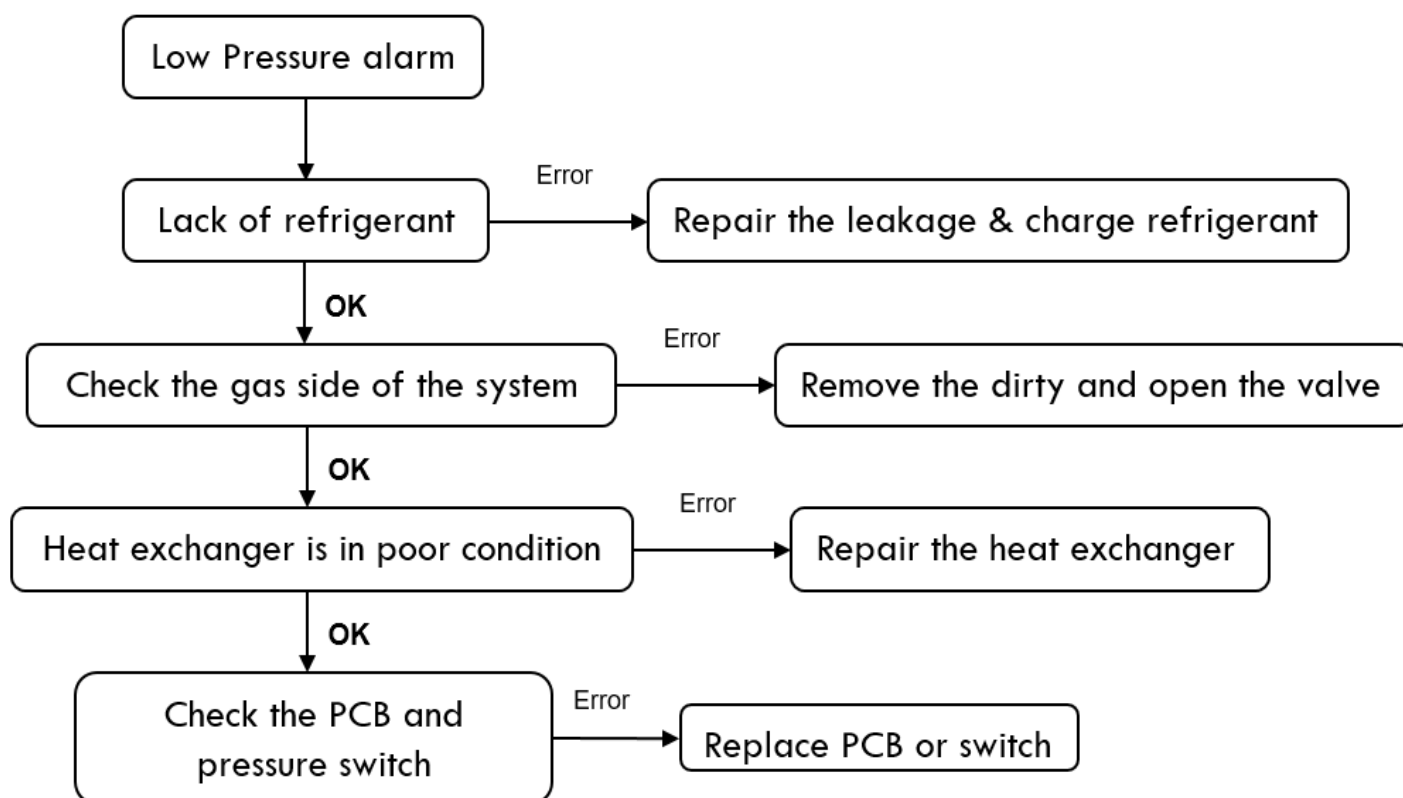


### 3.7 High pressure alarm

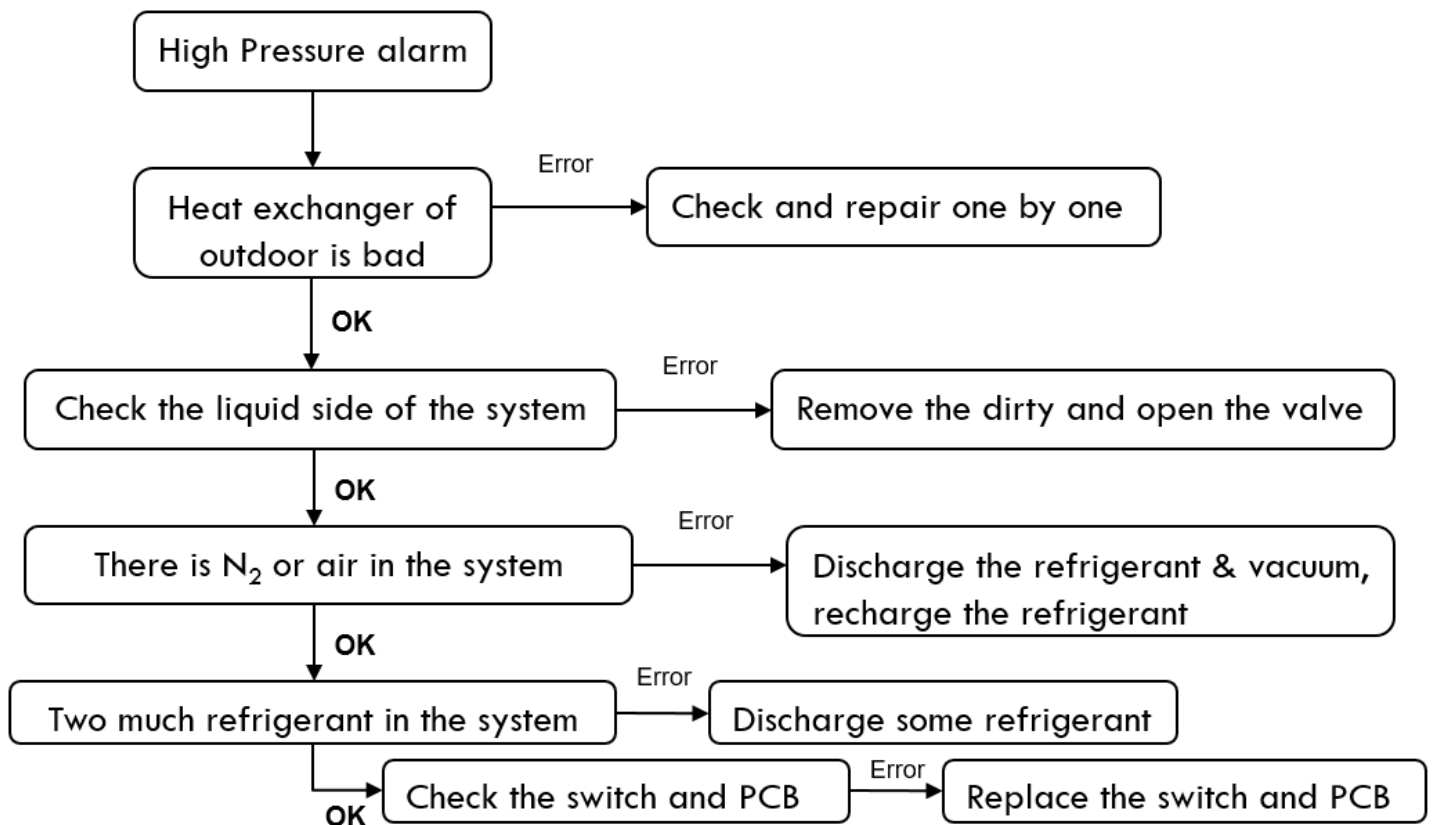

### 3.8 T3 High temperature protection

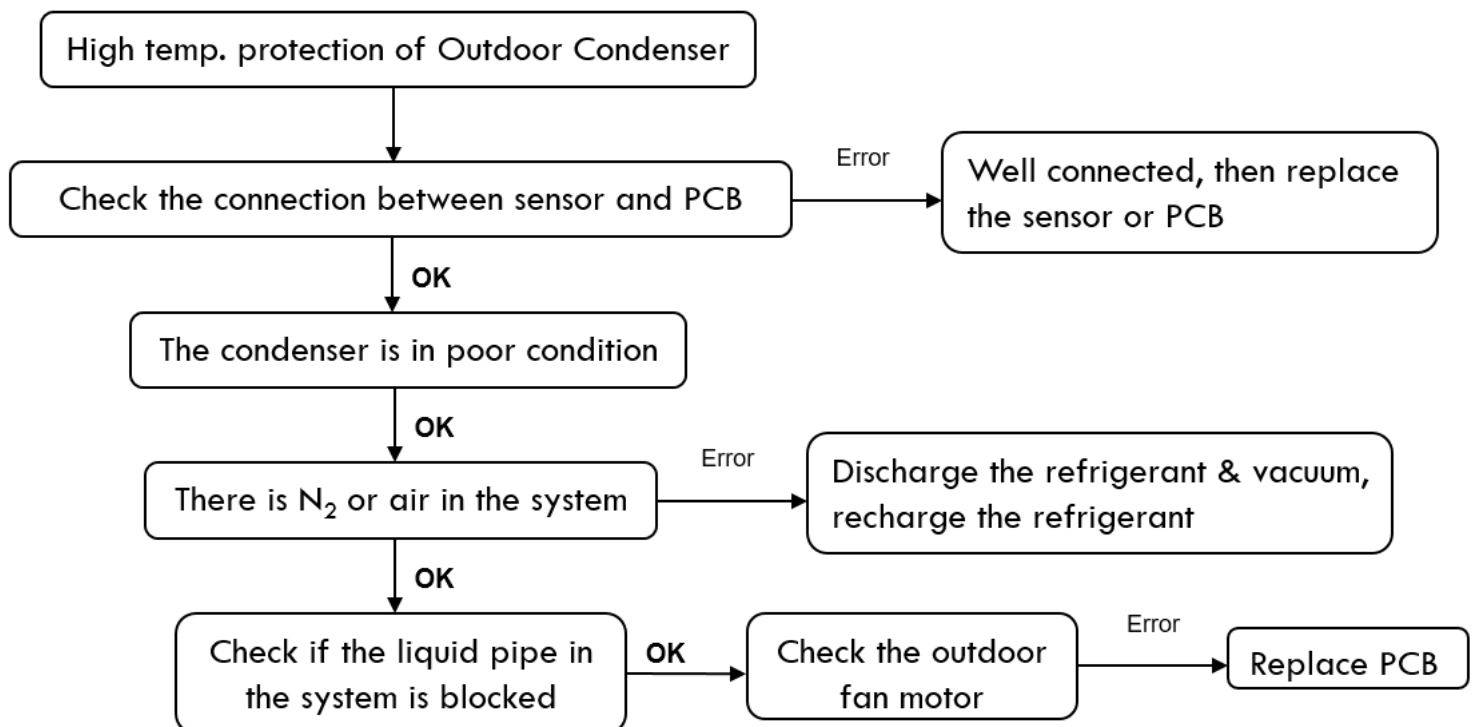


### 3.9 High exhaust temperature protection

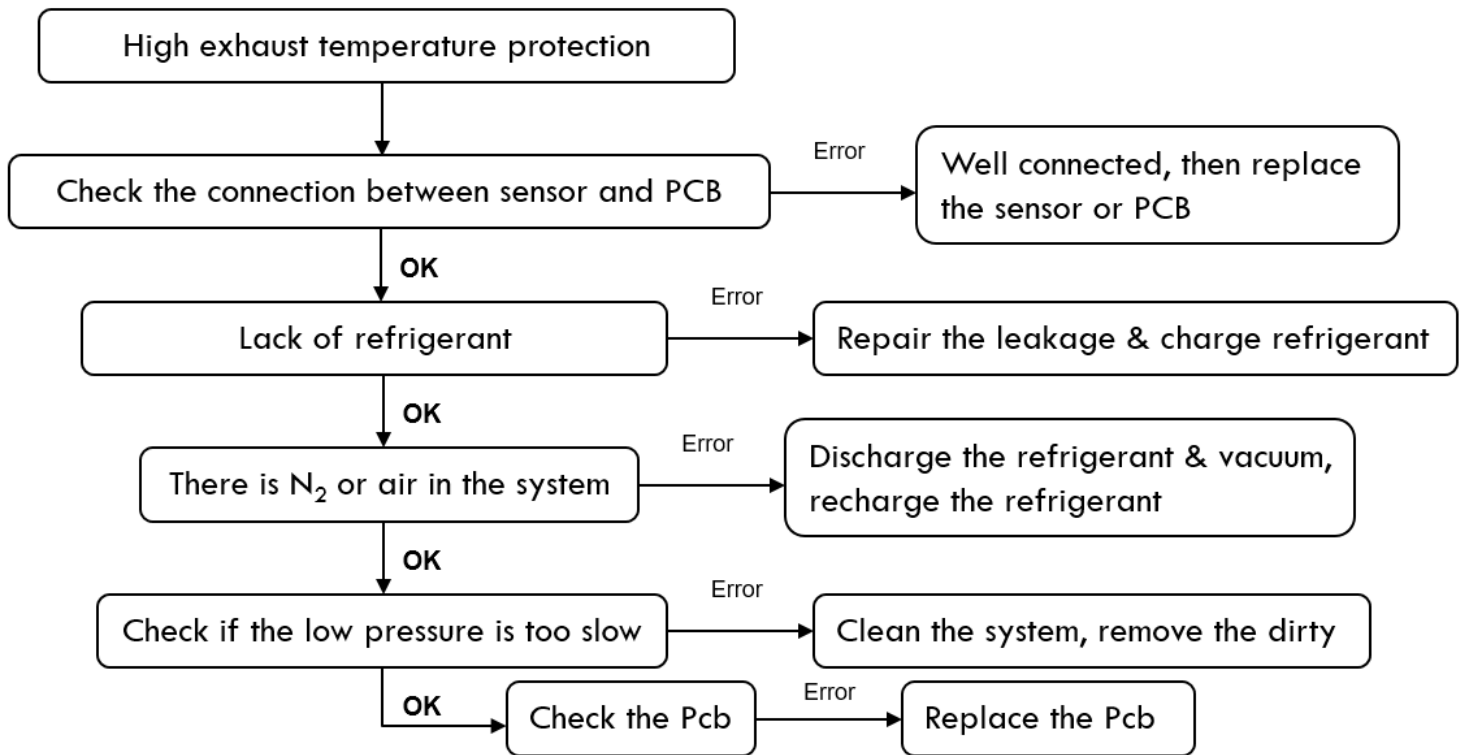

## 4. Exploded views and part list

### *Air Handler Indoor unit*

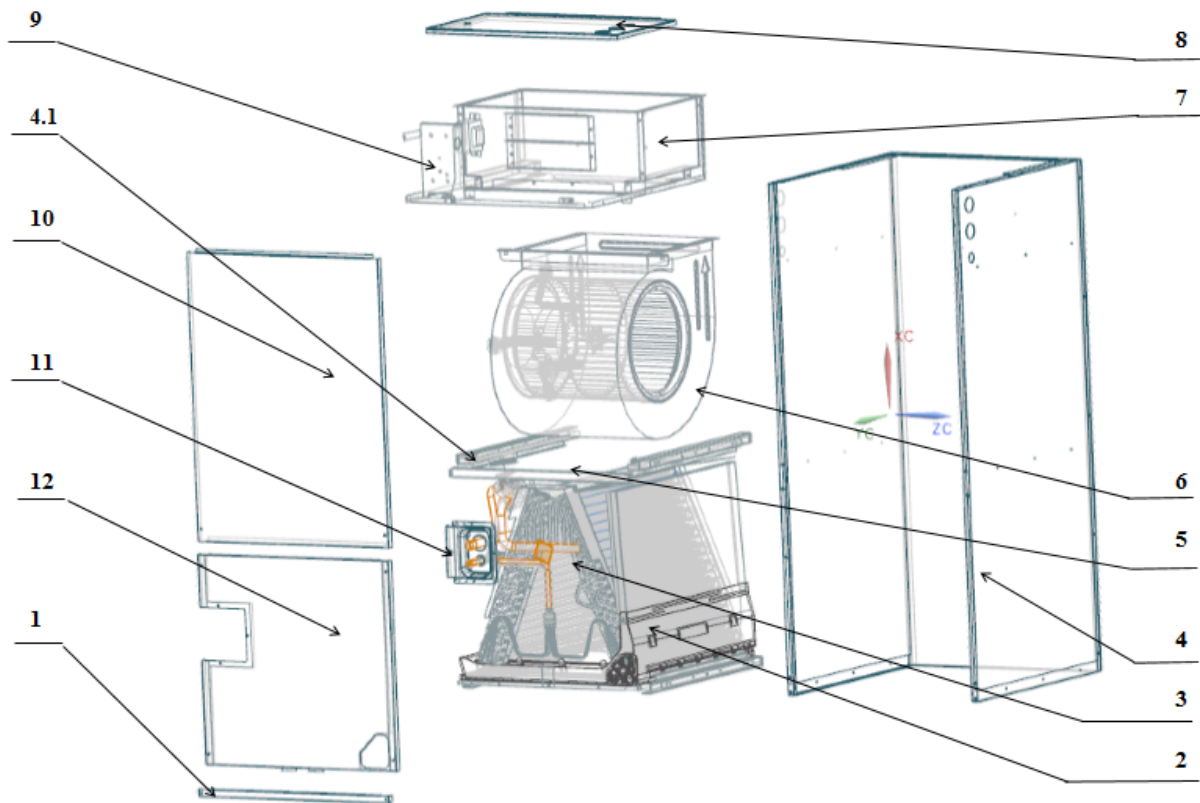


No.	Part Name	Quantity	No.	Part Name	Quantity
1	Filter Cover plate	1	4.1	Water pan supporter assembly	4
2	Water pan components	1	5	Supporter	2
2.1	Water pan# 1	1	6.1	Right Volute Wind Wheel	1
2.2	Water pan# 2	1	6.2	Indoor Motor	1
2.3	Water pan fixed block	1	7	Fan Motor Fixing plate assembly	1
2.4	Water pan brace	2	7.1	Fan Motor Fixing plate	1
3	Evaporator parts	1	7.2	Wind Wheel Fixed Block	2
3.0	Evaporator assembly	1	7.3	Fixed plate on air duct	1
3.1	Air header Assembly	1	7.4	Stator	2
3.2	Diverter Assembly	1	7.5	air duct left stationary plate	1
3.3	Evaporator	2	7.6	air duct right stationary plate	1
3.4	Evaporator Baffle	1	8	Cover of electric control assembly	1
3.5	Evaporator Baffle	1	9	Electronic Control Components	1

## 14SEER AIR HANDLER SYSTEM TECHNICAL MANUAL

3.6	Evaporator Water Baffle #1	2	9.1	Electronic Control Mounting Plate	1
3.7	Evaporator Water Baffle #2	1	9.2	Main Board	1
3.8	Evaporator Water Baffle #3	1	9.3	Transformer	1
3.9	Evaporator Fixing Plate #1	1	10	Upper side plate assembly	1
3.10	Evaporator Fixing Plate #2	1	11	Pipe Cover plate assembly	1
3.11	Evaporator Junction Plate	1	12	Lower side plate assembly	1
4	Chassis assembly	1			

### *Top discharge outdoor unit*

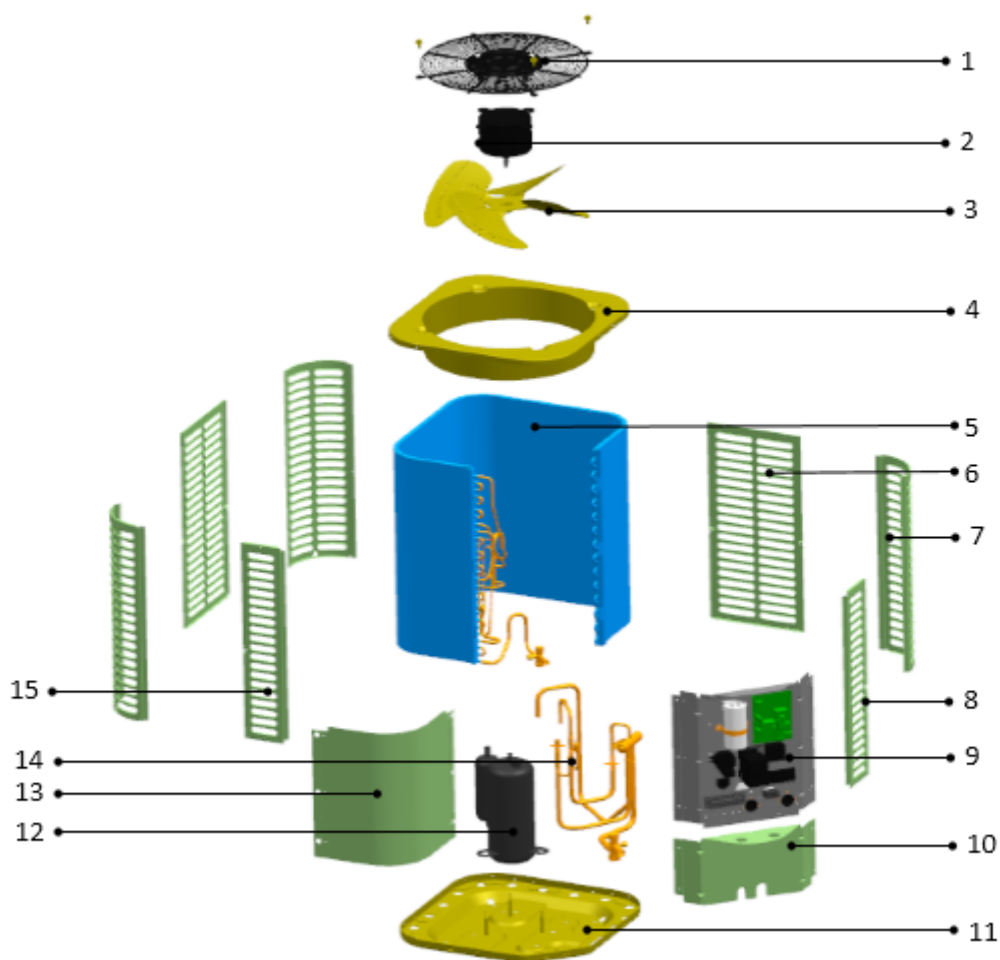

No.	Part Name	Quantity	No.	Part Name	Quantity
1	Cover net	1	9	Electronic components	1
2	Outdoor motor	1	9.1	Electric install board weld assembly	1
3	Axial-flow fan	1	9.2	AC Contactor	1
4	Top cover assembly	1	9.3	Fan motor capacitor	1
5	Condenser assembly	1	9.4	Compressor capacitor	1

**14SEER AIR HANDLER SYSTEM TECHNICAL MANUAL**

5.1	Condenser	1	10	Left side panel	1
5.2	Condenser input pipe assembly	1	11	Chassis assembly	1
5.3	Condenser output pipe assembly	1	12	Compressor	1
5.3.1	High-pressure valves weld assembly	1	13	Top panel	1
5.3.1.1	S.TL-ZL-FTF-A02	1	14	Low pressure valve welding components	1
6	Rear side-panel	2	14.1	Block valve body	1
7	Support board	3	14.2	Pressure switch	1
8	Right side panel	1	15	Left side panel	1